



GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

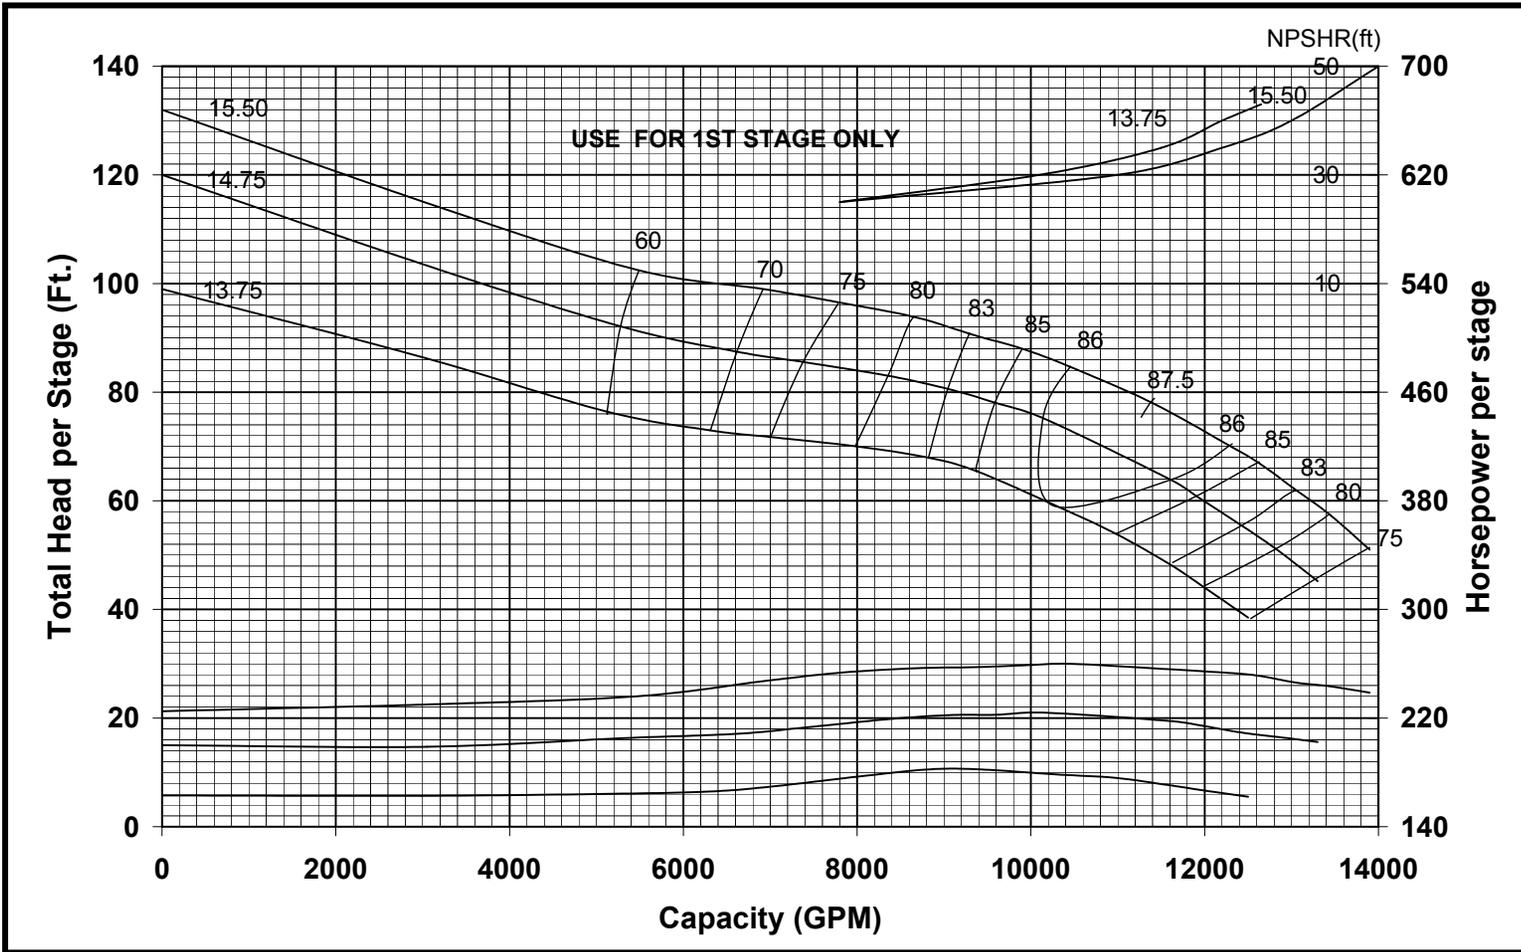

<b>Curve No.</b> <b>E6624GAPC1</b>	
<b>Model</b>	<b>24GHC</b>
<b>RPM</b>	<b>1180</b>
<b>EFFICIENCY CORRECTION</b>	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	
<b>Impeller</b>	<b>ENCLOSED</b>
<b>Ns =</b>	<b>4774</b>
<b>K =</b>	<b>60.0 LBS/FT</b>
<b>K (Bal.)=</b>	<b>N/A</b>
Bowl O.D.	24.25"
Bowl Lateral	1.62"
Max. PSI	300
Min. Subm	57"
<b>GOULDS PUMPS</b>	
<b>TURBINE OPERATIONS</b>	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	

GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

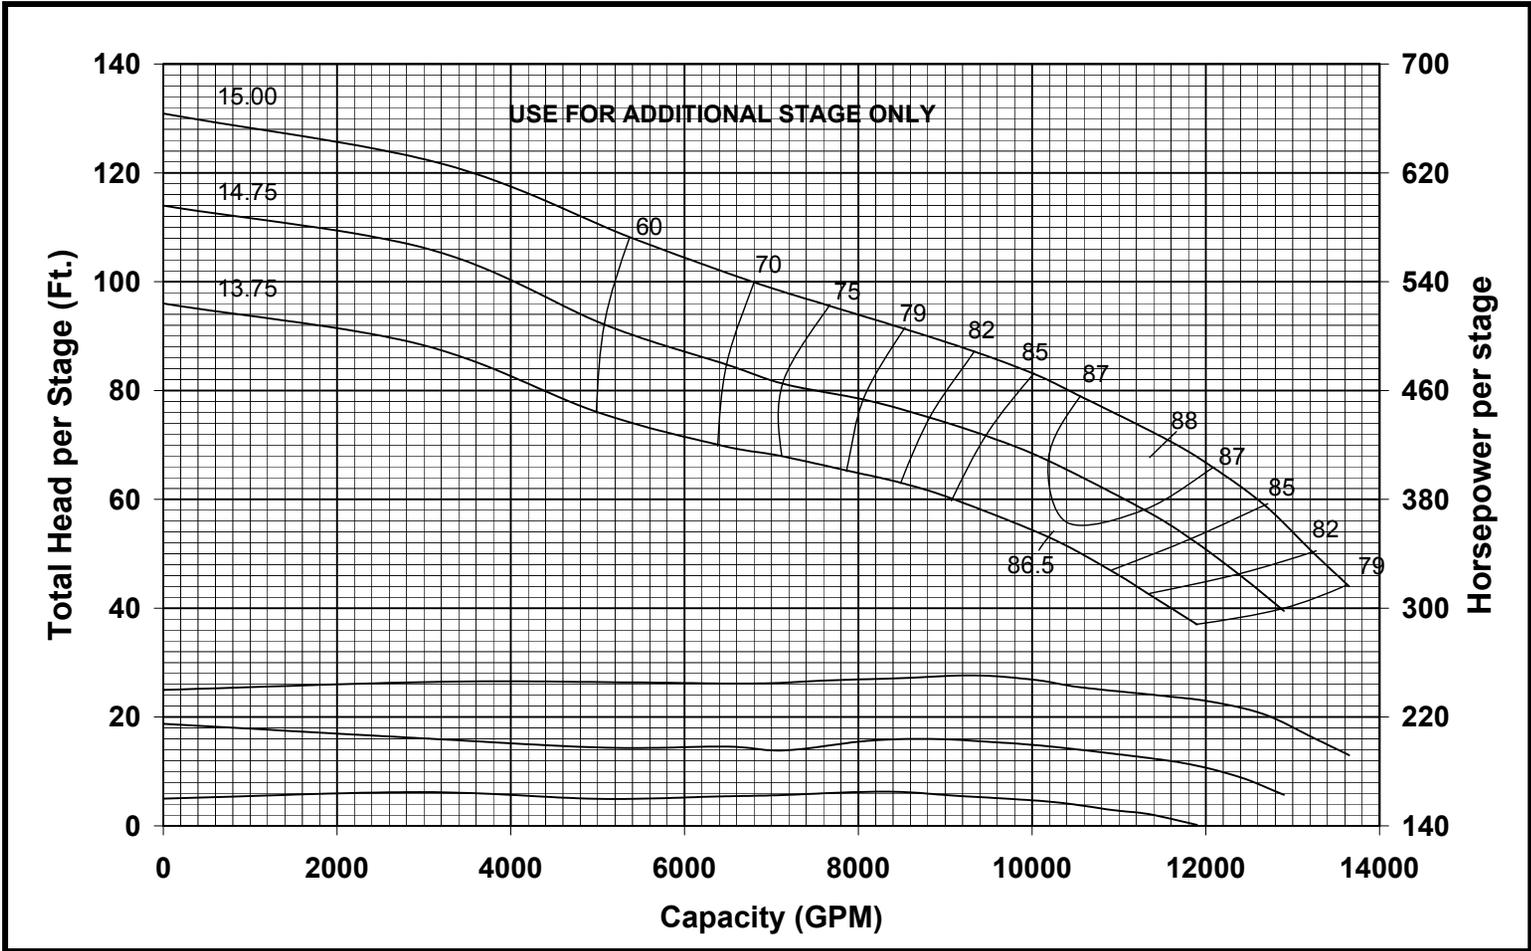

<b>Curve No.</b> <b>E6624GBPC0</b>	
<b>Model</b>	<b>24GHC</b>
<b>RPM</b>	<b>1180</b>
<b>EFFICIENCY CORRECTION</b>	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	
<b>Impeller</b>	<b>ENCLOSED</b>
<b>Ns =</b>	<b>5195</b>
<b>K =</b>	<b>60.0 LBS/FT</b>
<b>K (Bal.)=</b>	<b>N/A</b>
Bowl O.D.	24.25"
Bowl Lateral	1.62"
Max. PSI	300
Min. Subm	57"
<b>GOULDS PUMPS</b>	
<b>TURBINE OPERATIONS</b>	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	