LAYNE & BOWLER, INC.
MEMPHIS, TENN.

DEEP WELL PUMP TEST PERFORMANCE CHART

TEST NO. 7037
DATE 3-16-62

SIZE DISCHARGE COLUMN	14 x 2 3/16	IMPELLER	16 M15	PUMP NO	
SIZE OF SUCTION PIPE	BELL	FILING	NONE	ORDER NO	X-946
TYPE OF LUBRICATION	WATER	DIAMETER	1 1/2 To 11 27/32		TRIM INFORMATION ON 16 EM
				CUSTOMER	FULL DIA SEE 6901
				SUBSIDIARY	1/2" TRIM SEE 6931
					1" TRIM SEE 6987
				SIZE OF PUMP	16"
				TYPE OF PUMP FIGURE	EM
				NUMBER OF STAGES	2
				R P M	1750

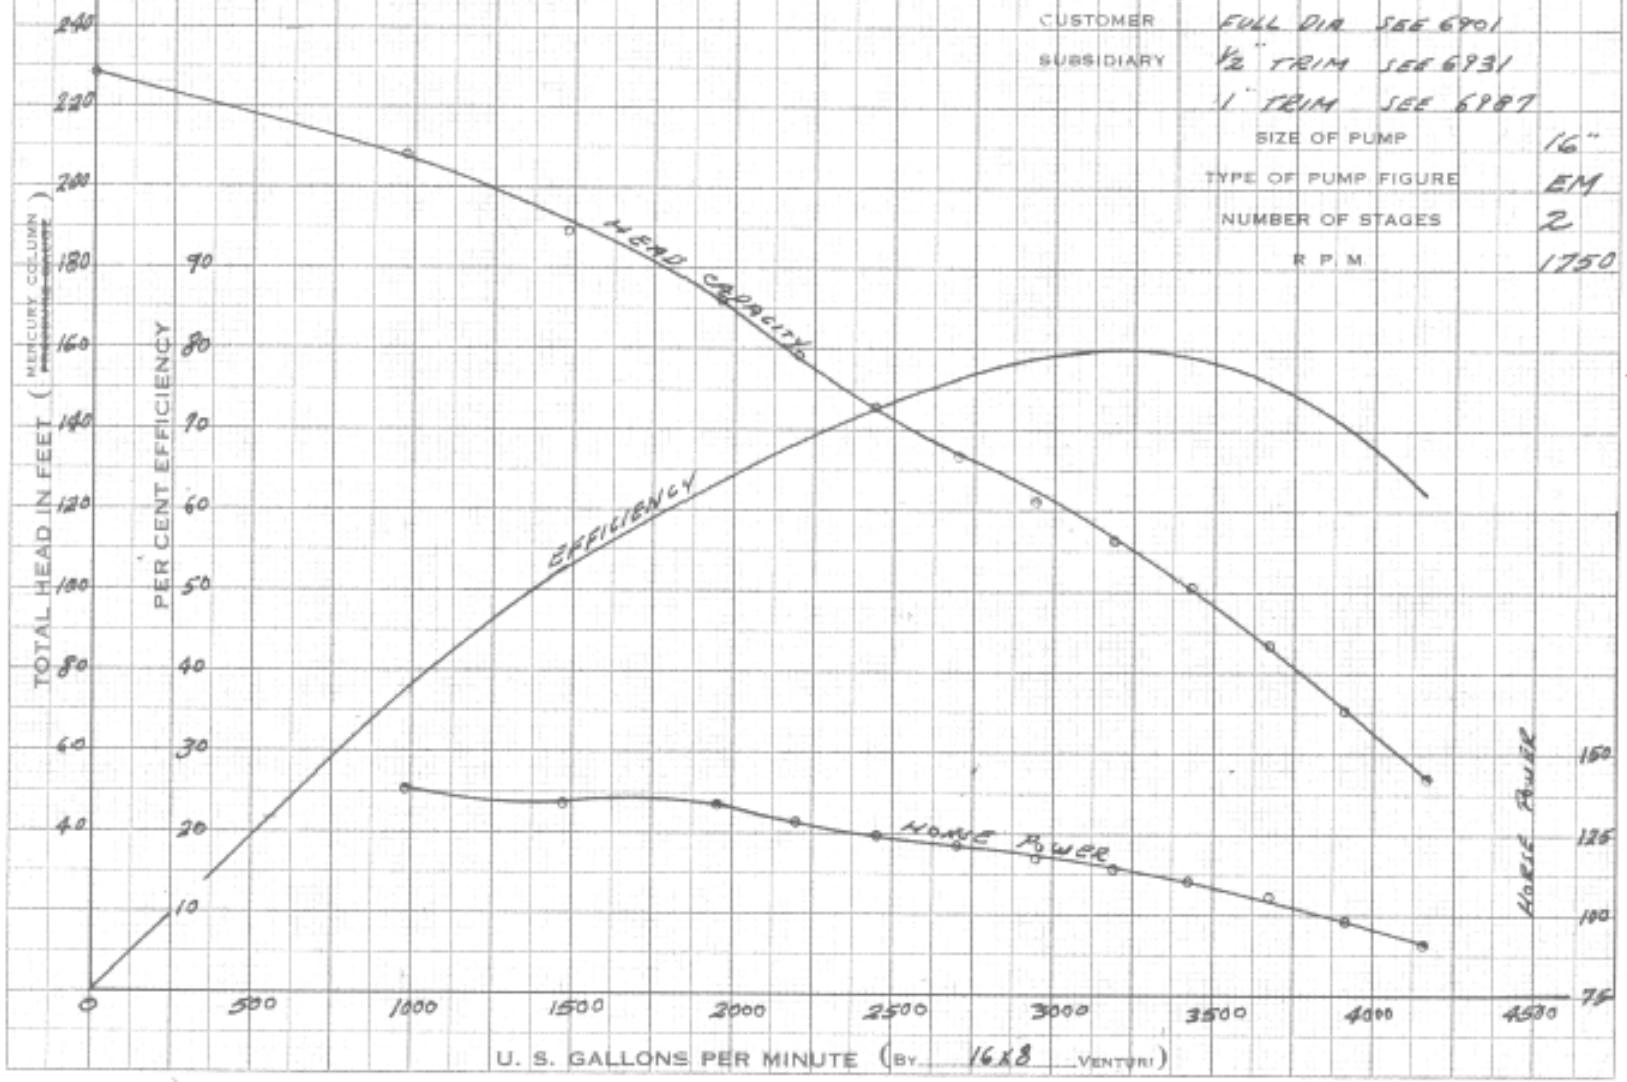

LAYNE & BOWLER, INC.
MEMPHIS, TENN.

DEEP WELL PUMP TEST
PERFORMANCE CHART

TEST NO. 6701
DATE 10/19/61

SIZE DISCHARGE COLUMN 14x2 3/16
SIZE OF SUCTION PIPE 0
LUBRICATION WATER

IMPELLER BM15
FILING NONE
DIAMETER FULL

PUMP NO. —
ORDER NO. X946

FIRST TEST OF 16" EM
INTS - NO ENAMEL ~~CUSTOMER~~ NO ENAMEL ON INTS
~~SUBSIDIARY~~ INTS - NO FILING
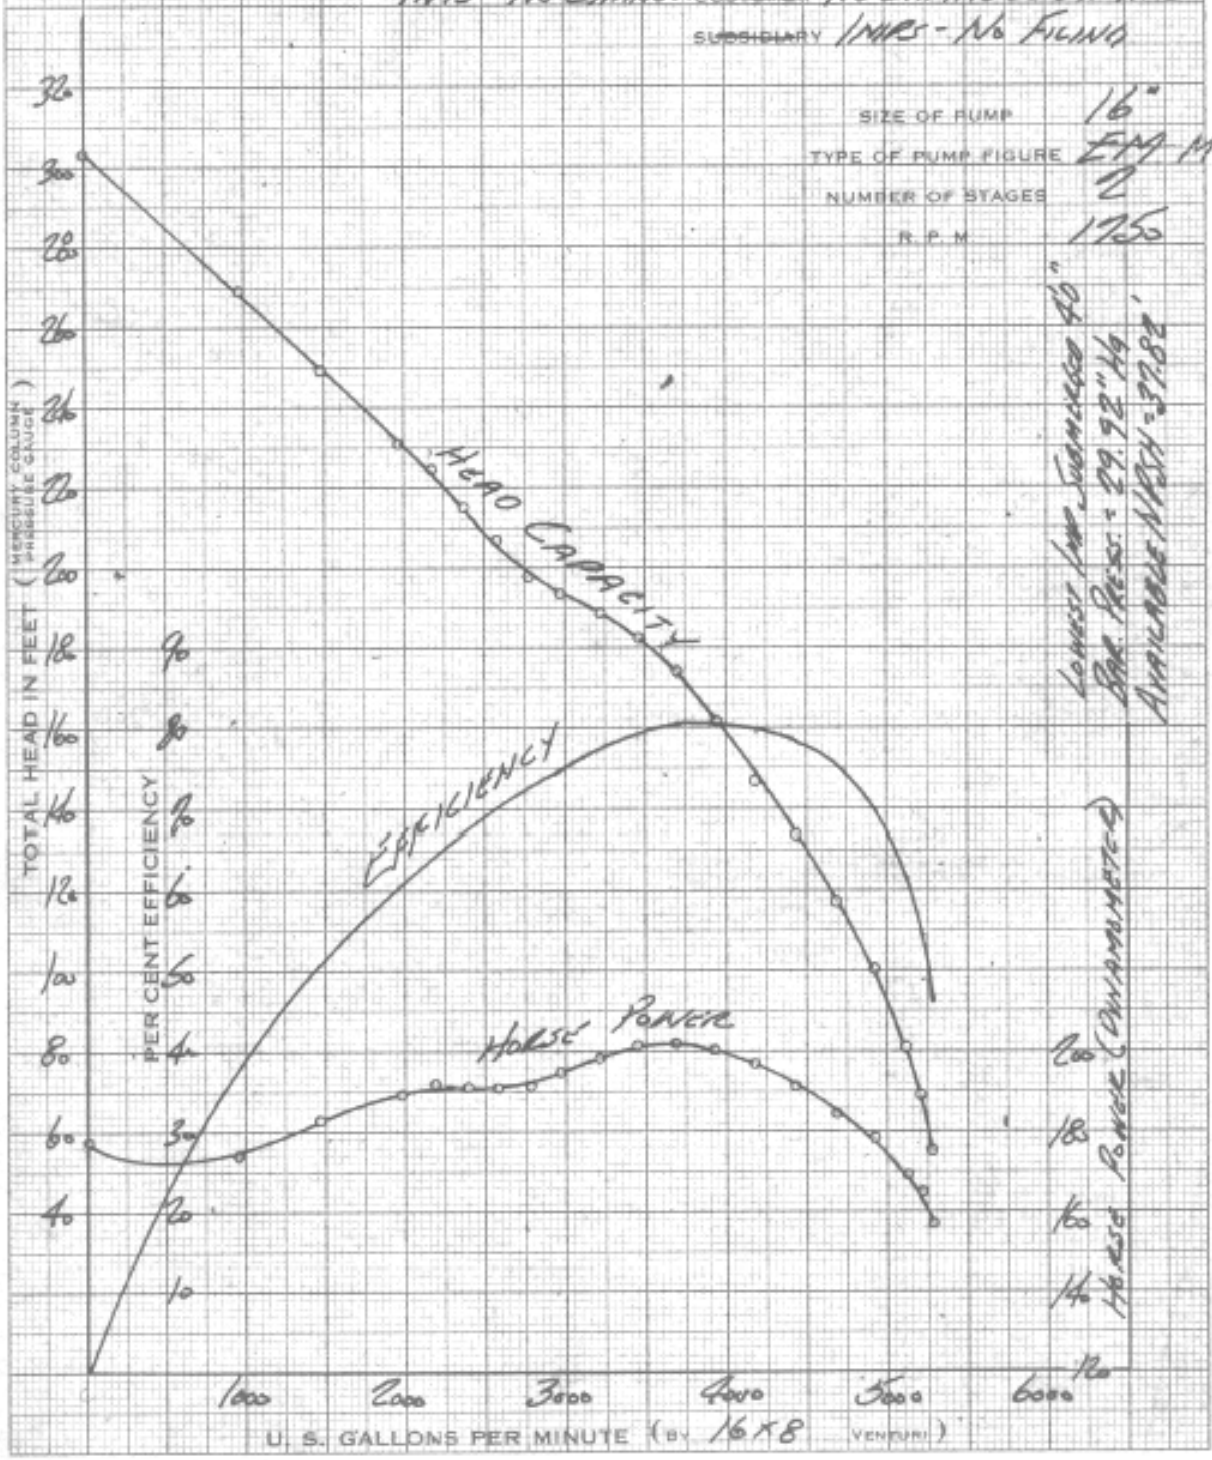
SIZE OF PUMP 16"
TYPE OF PUMP FIGURE EM-M1
NUMBER OF STAGES 2
R.P.M. 1750