Customer _____ Worthington S.O. _____
Project _____ Proposal/Order No. _____
Cust. Proposal/Order No. _____ Certified By _____
Customer Item No. _____ Date _____

Liquid/Service _____ Sp. Gr. _____ Visc. _____ SSU
Capacity _____ Head _____ Temp. _____ °F/°C Consistency _____ %

WORTHINGTON PUMP PERFORMANCE DATA

CAPACITY M³/HR

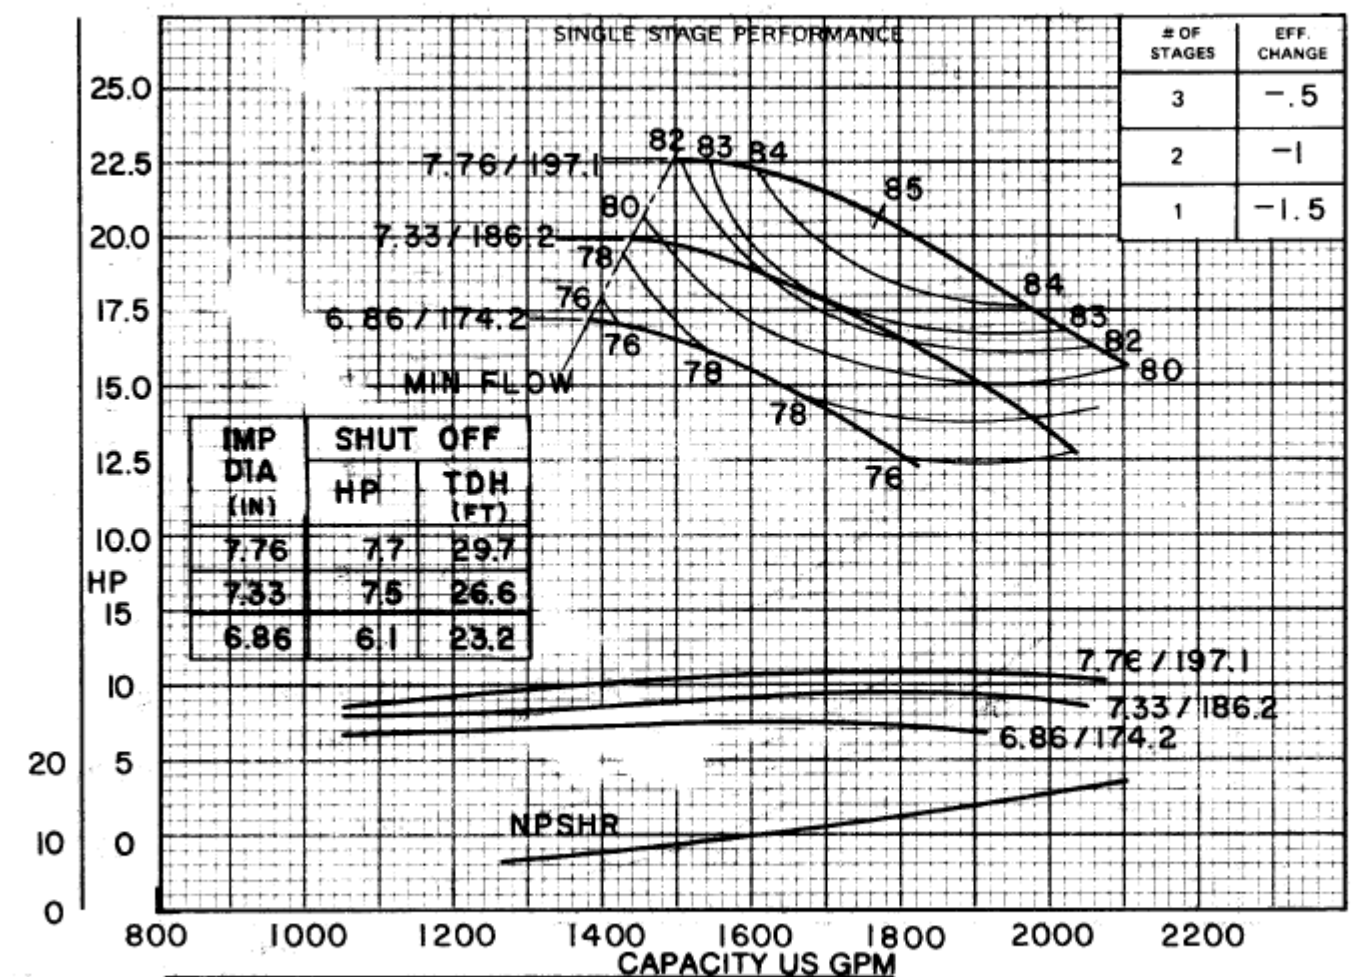

# OF STAGES	EFF. CHANGE
3	−.5
2	−1
1	−1.5

IMP DIA (IN)	SHUT OFF HP	SHUT OFF TDH (FT)
7.76	7.7	29.7
7.33	7.5	26.6
6.86	6.1	23.2

CURVE NO.	SIZE	RPM
A-24210K	12HHH270	1160