SNOTEL Yesterday's Minimum Temperature Anomaly (Degrees F)

Jun 26, 2016

NOTE: anomaly calculations are based on data through water year 2012; water years 2013, 2014 and 2015 are not analyzed.

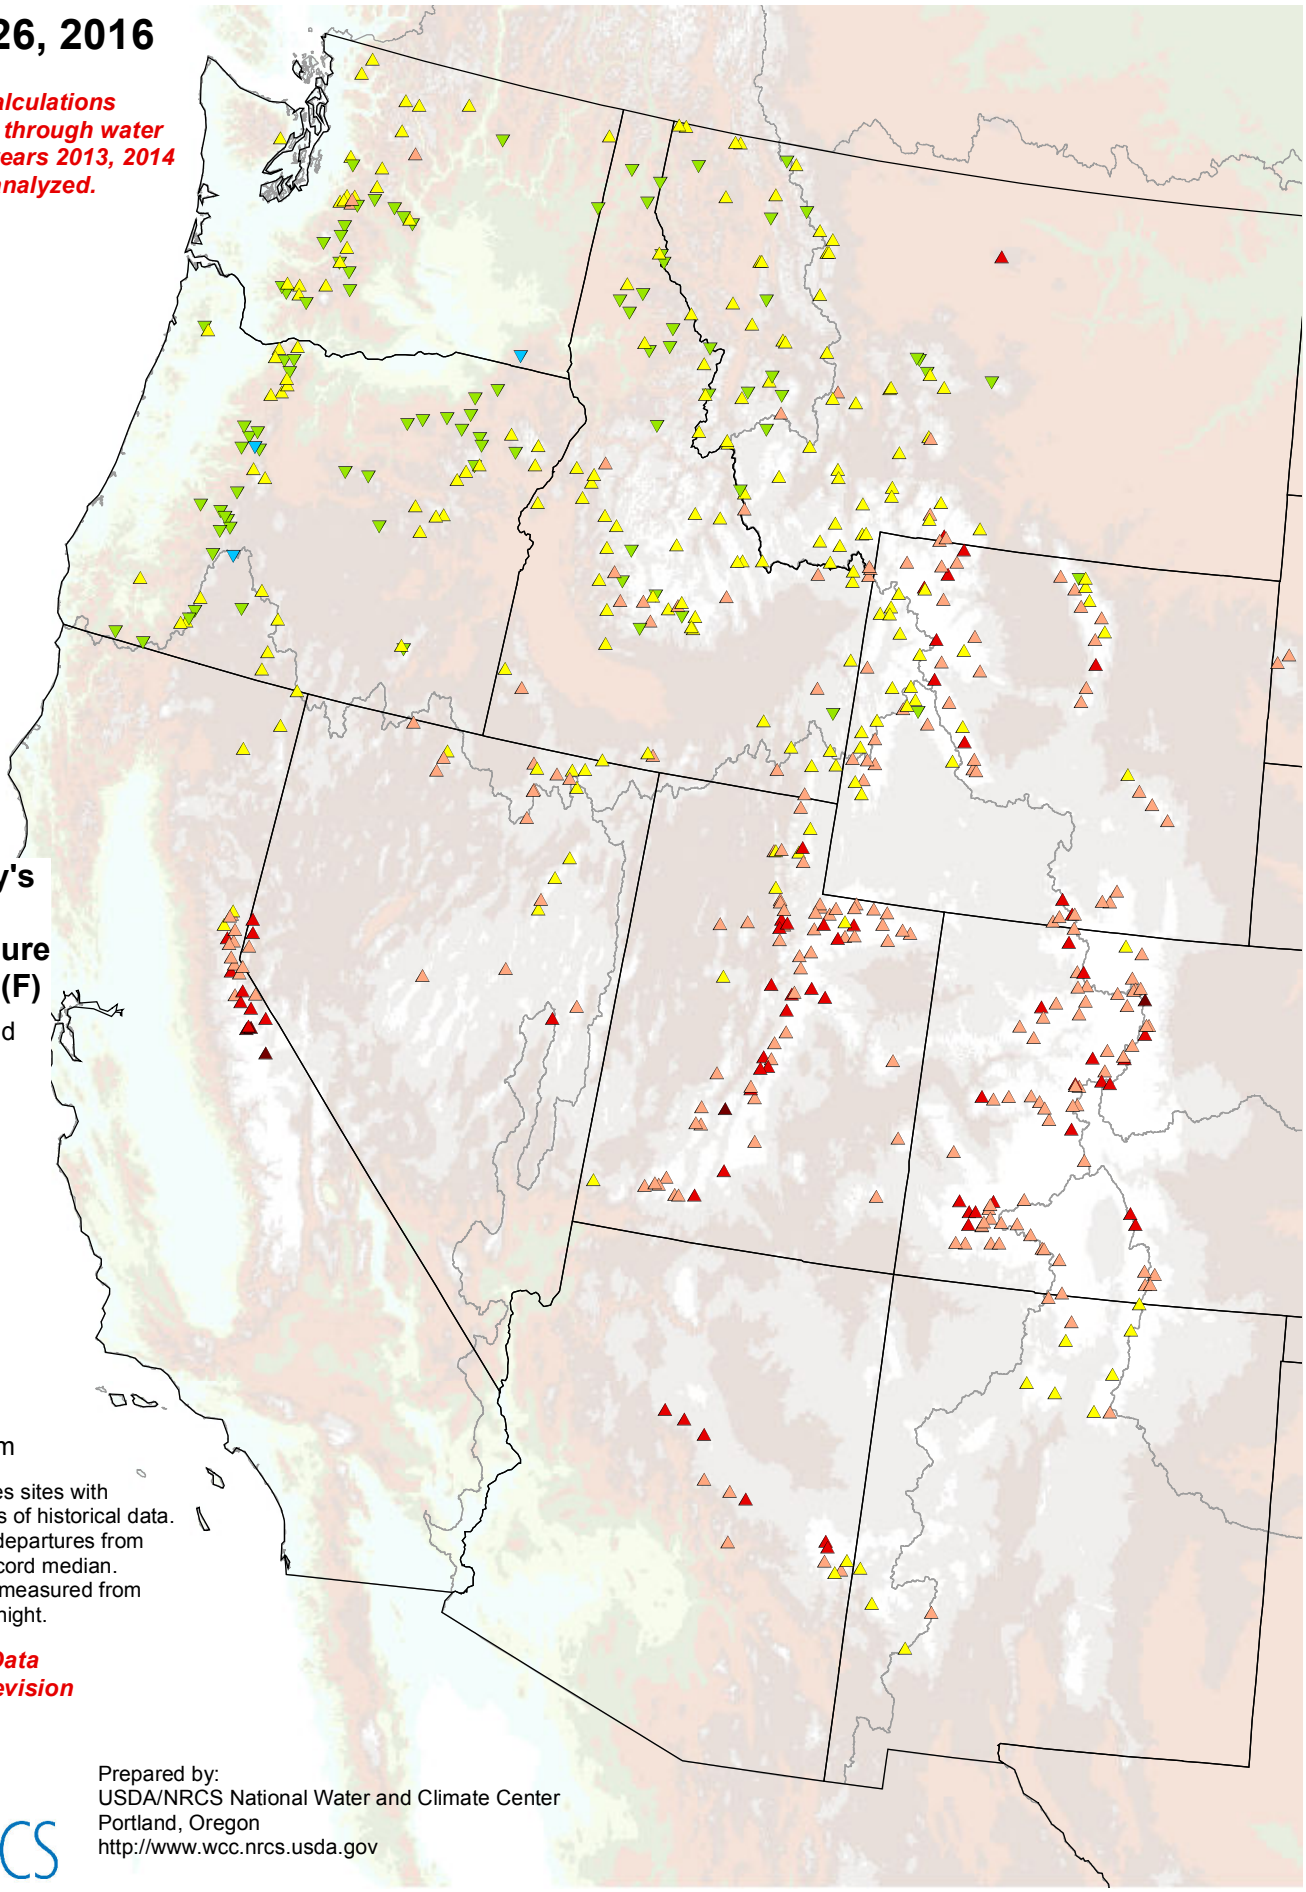

Yesterday's Minimum Temperature Anomaly (F)

- < -20 cold
- -20 - -15
- -15 - -10
- -10 - -5
- -5 - 0
- 0 - 5
- 5 - 10
- 10 - 15
- 15 - 20
- >20 warm

Analysis includes sites with at least 15 years of historical data. Anomalies are departures from the period of record median. Temperature is measured from midnight to midnight.

Provisional Data Subject to Revision

USDA NRCS

Prepared by:
USDA/NRCS National Water and Climate Center
Portland, Oregon
http://www.wcc.nrcs.usda.gov