DATED JANUARY 1977
SUPERSEDES PAGE 419
DATED JULY 1976

MIXED FLOW

24 LM

IMP. DIA.	SHUT-OFF HEAD	SHUT-OFF HP	"K" FACTOR
A	104.7	373	133
B	92.4	269	133
C	80.2	228	133

MAX. SPHERES - 2.0
IMP. PATT. NO. - 24LM4A
CASE PATT. NO. -
DISCH. BOW - 24LM2
INTER. BOWL - 24LM4

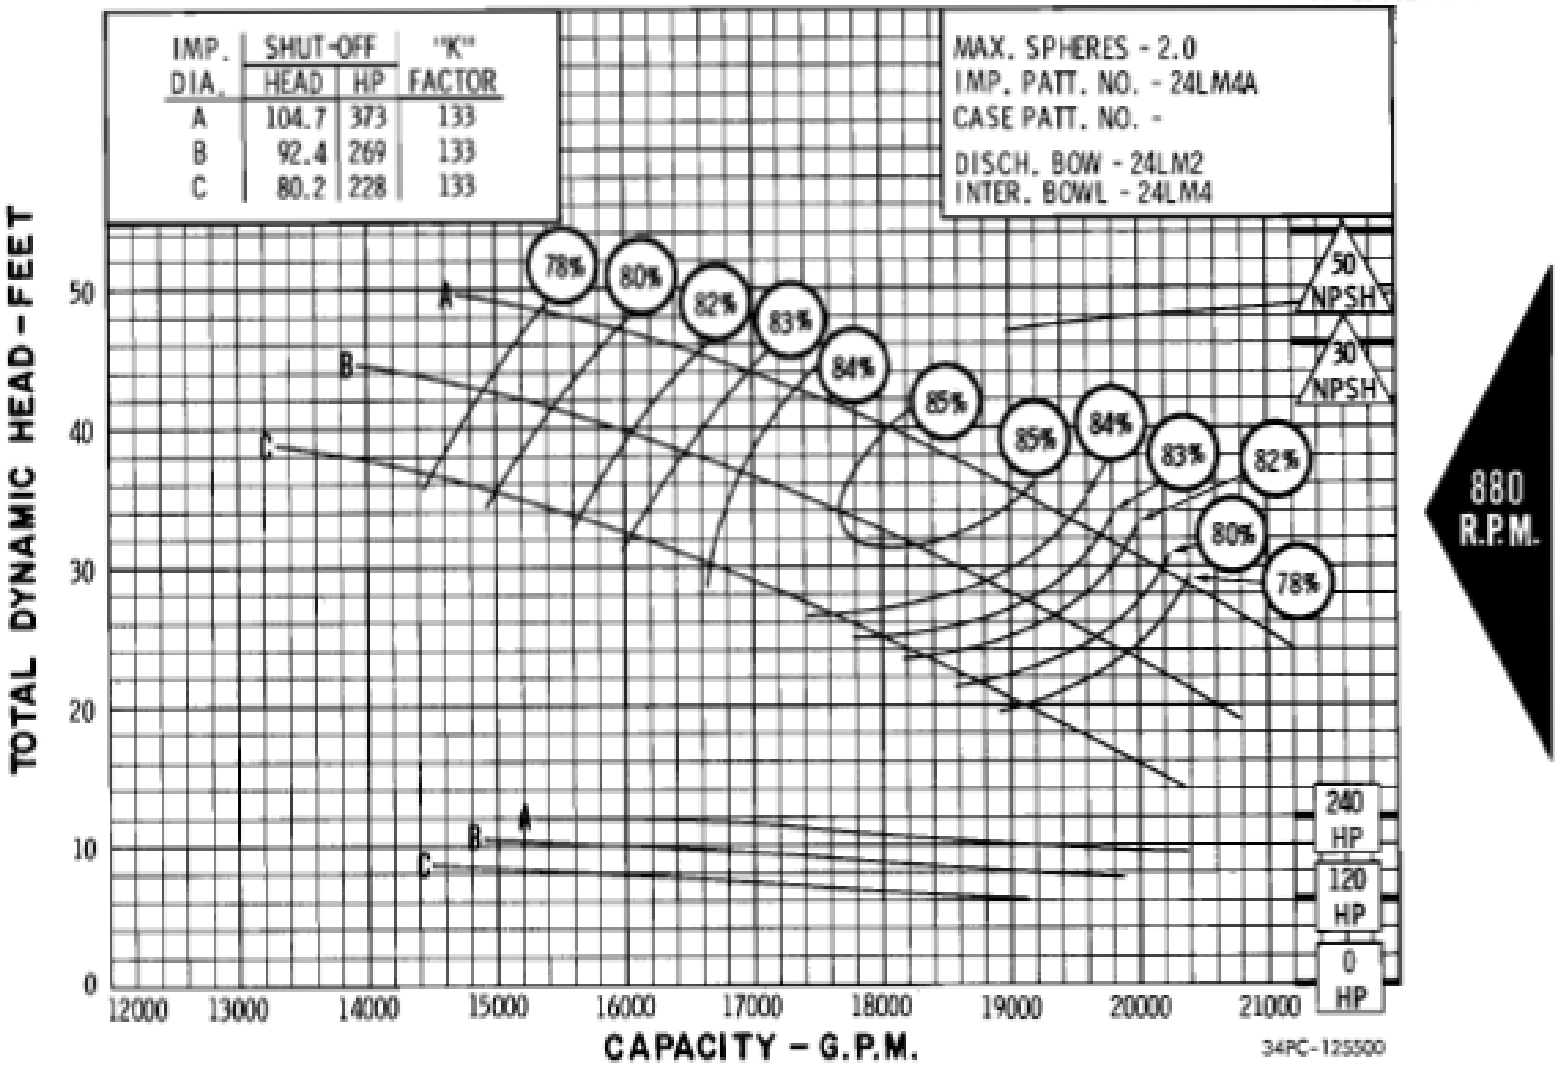

AURORA PUMP
A UNIT OF GENERAL SIGNAL
800 AIRPORT ROAD · NORTH AURORA, ILLINOIS · 60542