


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

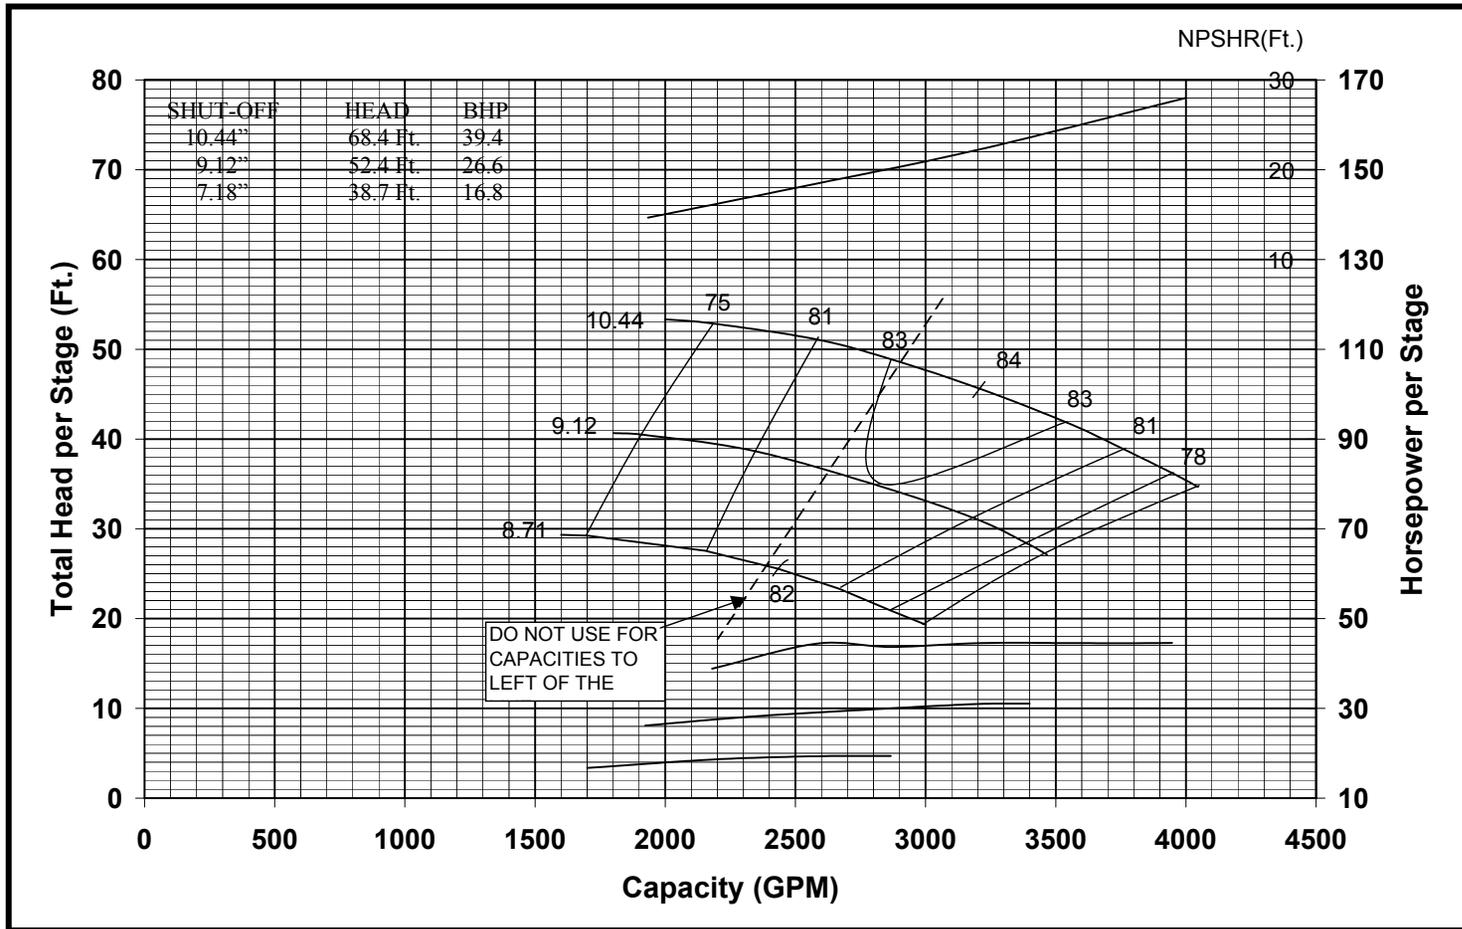

Curve No.	
E6616DDPC0	
Model 16DHHO	
RPM 1180	
EFFICIENCY CORRECTION	
1-STAGE	-3.0
2-STAGE	-1.5
3-STAGE	-1.0
4-STAGE	
Impeller OPEN	
Ns = 3790	
K = 42.0 LBS/FT	
K(Bal.)= N/A	
Bowl O.D.	15.25"
Bowl Lateral	0.88"
Max. PSI	240
Min. Subm	32"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	