



|                     |                 |             |                   |           |              |          |
|---------------------|-----------------|-------------|-------------------|-----------|--------------|----------|
| GOULDS PROPOSAL NO. | GOULDS S.O. NO. | INQUIRY NO. | CUSTOMER P.O. NO. | P.O. DATE | ITEM NO.     | CUSTOMER |
| PROJECT             | SERVICE         |             | GPM CAPACITY      | FT. TDH   | % EFFICIENCY | RPM      |

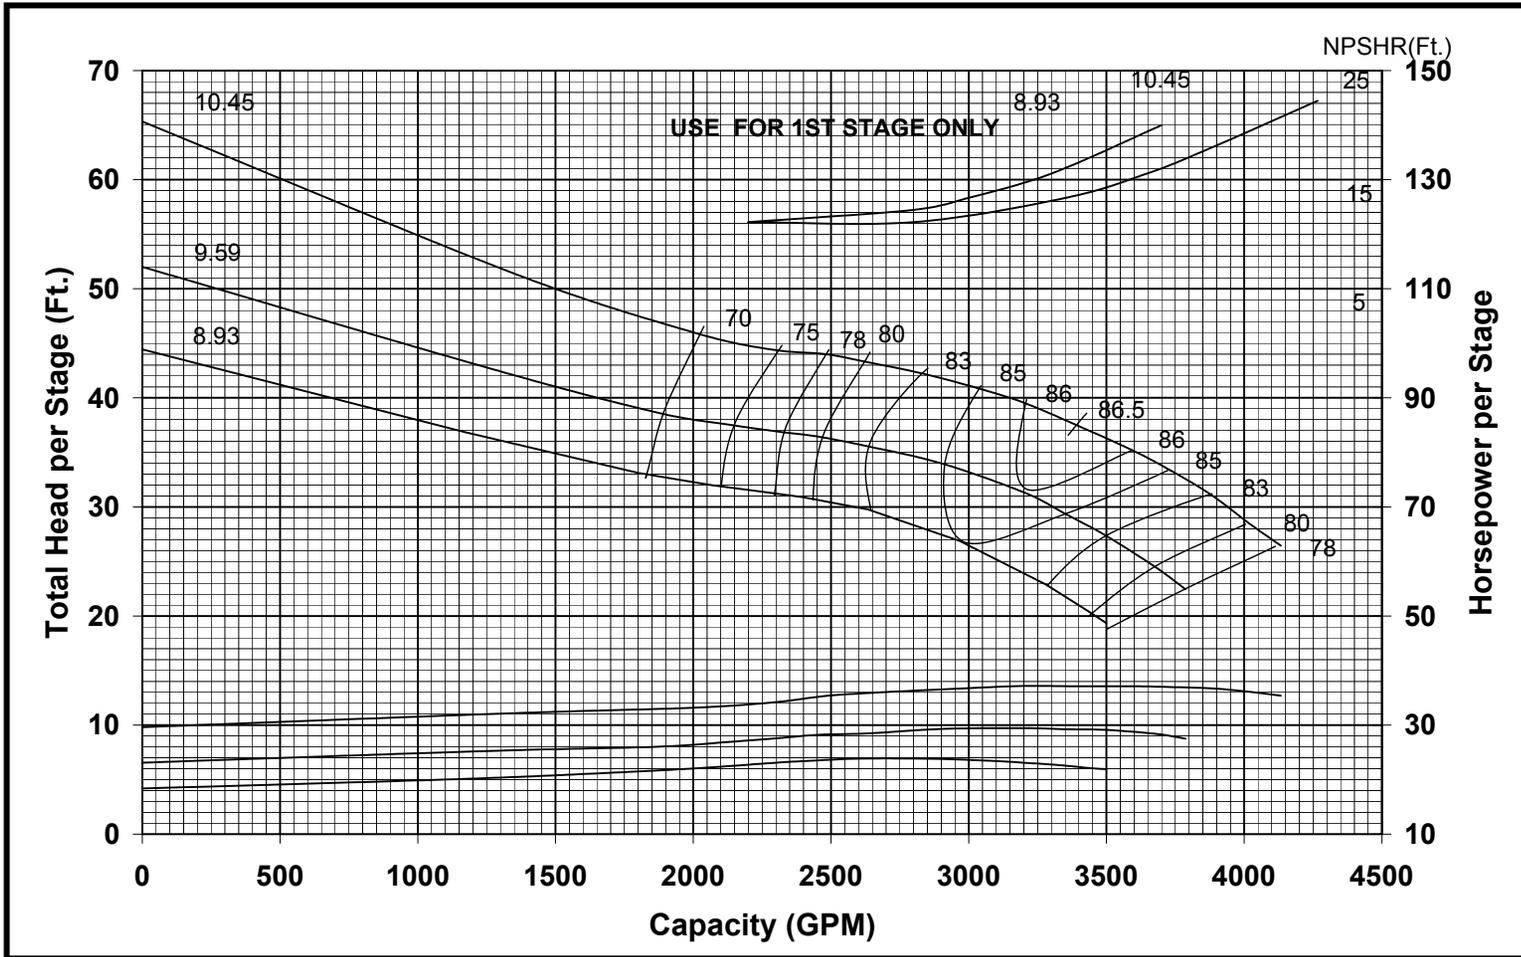

|  |                    |
|--|--------------------|
| <b>Curve No.</b>   |                    |
| <b>E6616RAPP0</b>  |                    |
| <b>Model</b>   | <b>16RGHC</b>      |
| <b>RPM</b>   | <b>1180</b>        |
| <b>EFFICIENCY CORRECTION</b>   |                    |
| 1-STAGE  |                    |
| 2-STAGE  |                    |
| 3-STAGE  |                    |
| 4-STAGE  |                    |
| <b>Impeller</b>  | <b>ENCLOSED</b>    |
| <b>Ns =</b>  | <b>4523</b>        |
| <b>K =</b>   | <b>24.0 LBS/FT</b> |
| <b>K(Bal.)=</b>  | <b>N/A</b>         |
| Bowl O.D.  | 16.0"              |
| Bowl Lateral   | 1.12"              |
| Max. PSI   | 420                |
| Min. Subm.   | 32"                |
| <b>GOULDS PUMPS</b>  |                    |
| <b>TURBINE OPERATIONS</b>  |                    |
| Lubbock, Texas   |                    |
| BOWL PERFORMANCE CURVE<br>BASED ON PUMPING CLEAR,<br>NON-AERATED WATER.<br>RATED POINT ONLY IS<br>GUARANTEED. CURVES<br>REPRESENT SINGLE STAGE<br>PERFORMANCE BASED ON<br>TEST OF MULTI-STAGE BOWL<br>ASSEMBLY. EFFICIENCY<br>CORRECTION IS REQUIRED<br>FOR LESSER STAGES. |                    |

|                     |                 |             |                   |           |              |          |
|---------------------|-----------------|-------------|-------------------|-----------|--------------|----------|
| GOULDS PROPOSAL NO. | GOULDS S.O. NO. | INQUIRY NO. | CUSTOMER P.O. NO. | P.O. DATE | ITEM NO.     | CUSTOMER |
| PROJECT             | SERVICE         |             | GPM CAPACITY      | FT. TDH   | % EFFICIENCY | RPM      |

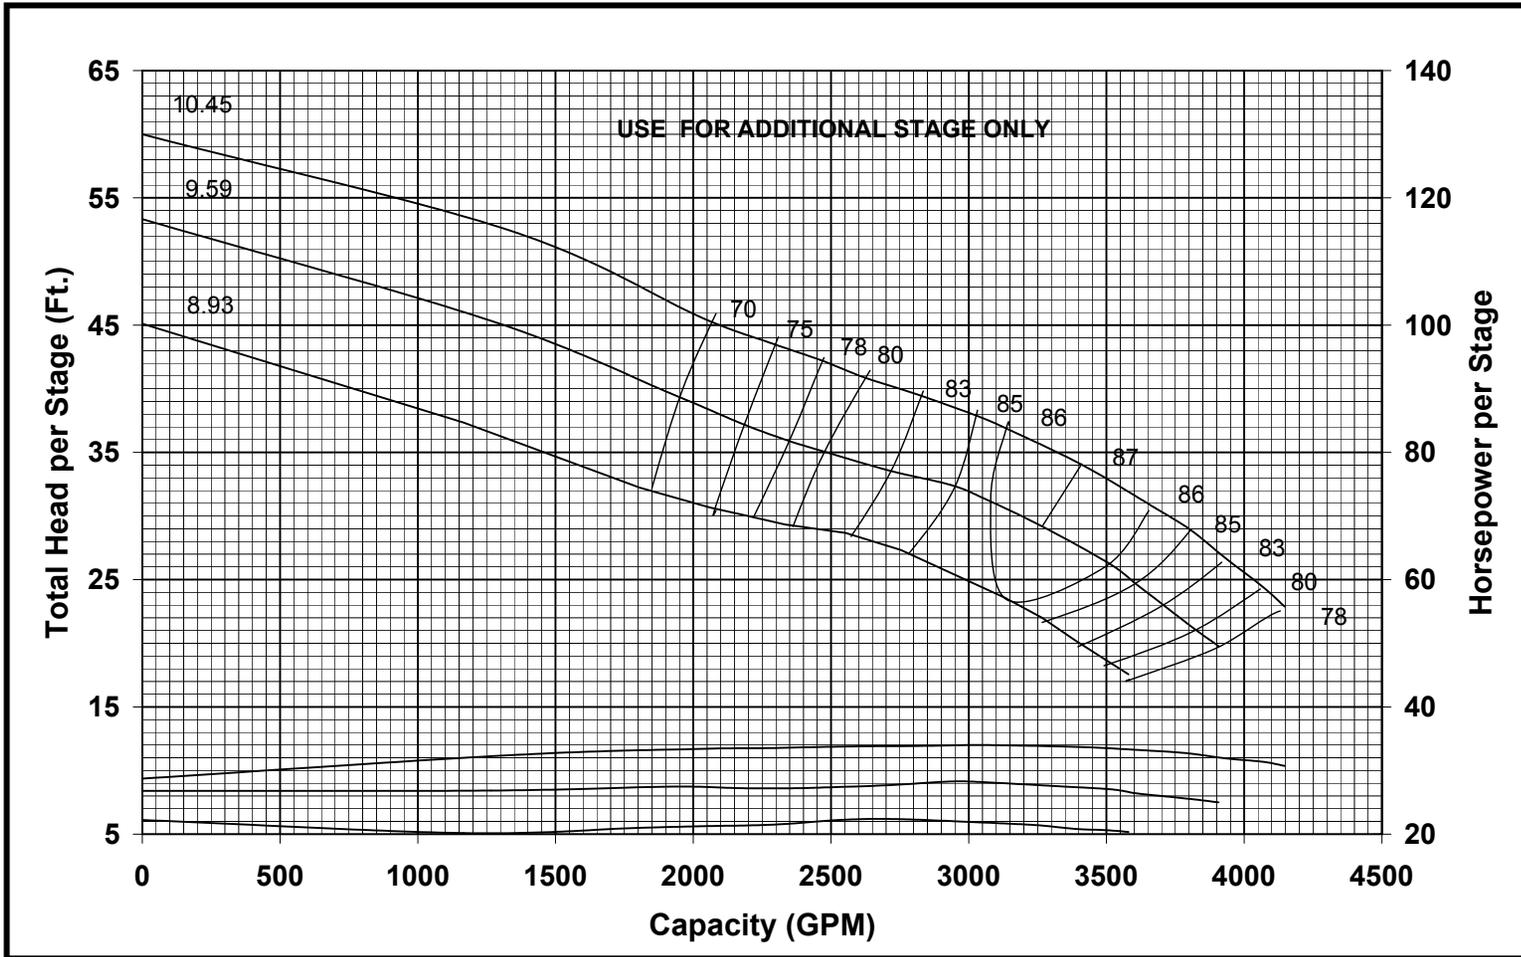

|  |                    |
|--|--------------------|
| <b>Curve No.</b>   |                    |
| <b>E6616RBPP0</b>  |                    |
| <b>Model</b>   | <b>16RGHC</b>      |
| <b>RPM</b>   | <b>1180</b>        |
| <b>EFFICIENCY CORRECTION</b>   |                    |
| 1-STAGE  |                    |
| 2-STAGE  |                    |
| 3-STAGE  |                    |
| 4-STAGE  |                    |
| <b>Impeller</b>  | <b>ENCLOSED</b>    |
| <b>Ns =</b>  | <b>4895</b>        |
| <b>K =</b>   | <b>24.0 LBS/FT</b> |
| <b>K(Bal.)=</b>  | <b>N/A</b>         |
| Bowl O.D.  | 16.0"              |
| Bowl Lateral   | 1.12"              |
| Max. PSI   | 420                |
| Min. Subm.   | 32"                |
| <b>GOULDS PUMPS</b>  |                    |
| <b>TURBINE OPERATIONS</b>  |                    |
| Lubbock, Texas   |                    |
| BOWL PERFORMANCE CURVE<br>BASED ON PUMPING CLEAR,<br>NON-AERATED WATER.<br>RATED POINT ONLY IS<br>GUARANTEED. CURVES<br>REPRESENT SINGLE STAGE<br>PERFORMANCE BASED ON<br>TEST OF MULTI-STAGE BOWL<br>ASSEMBLY. EFFICIENCY<br>CORRECTION IS REQUIRED<br>FOR LESSER STAGES. |                    |