



GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

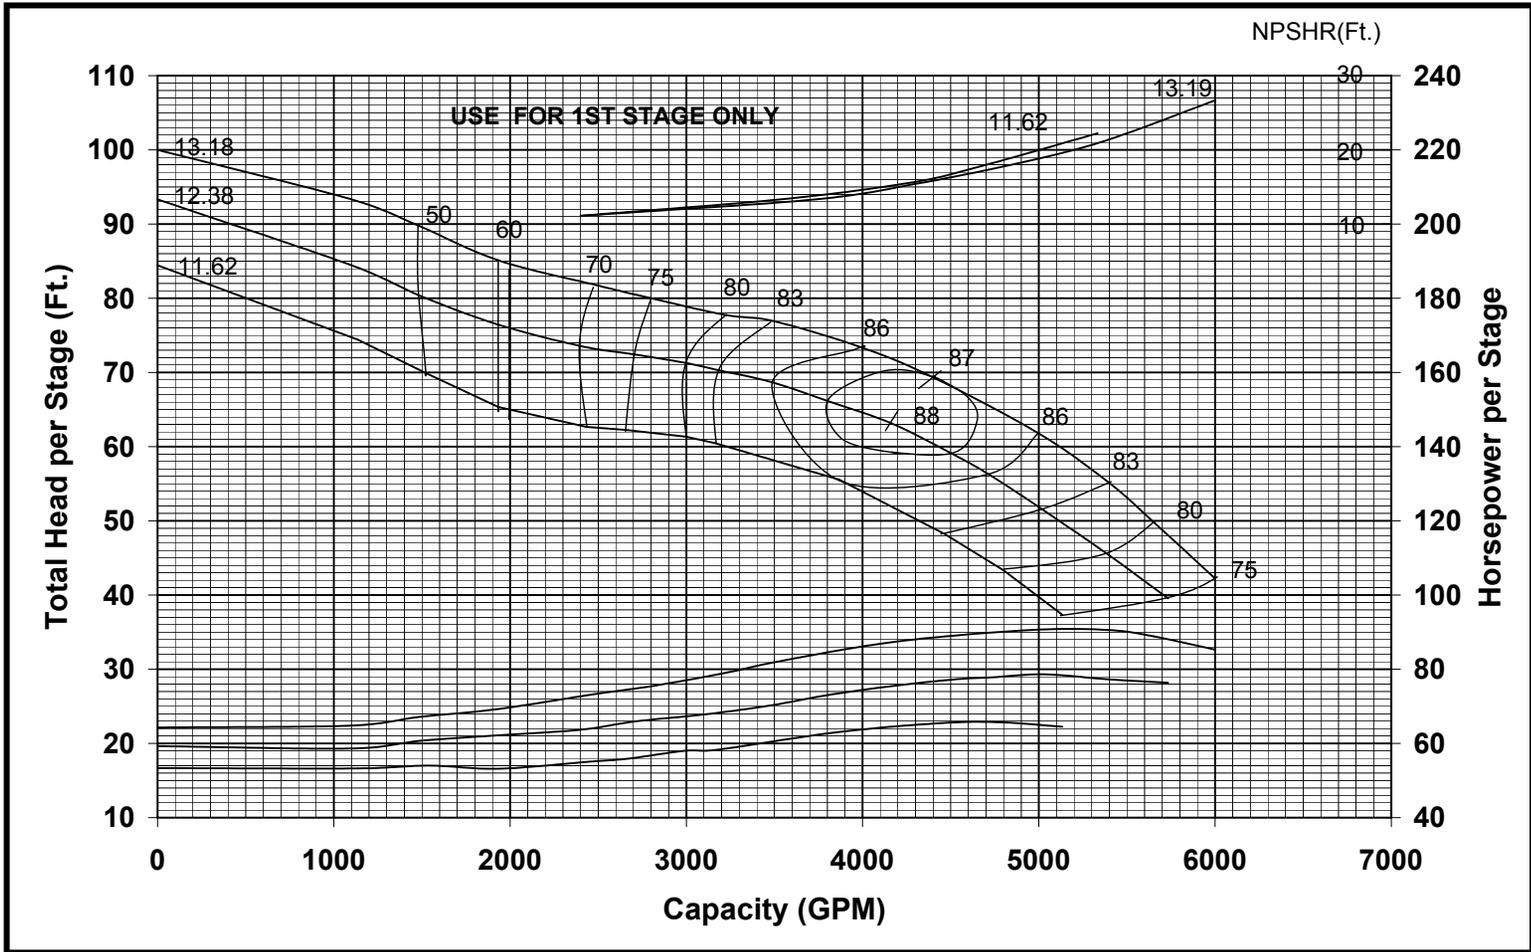

Curve No.	
E6620EBPC2	
Model	20EHC
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
4-STAGE	
Impeller	ENCLOSED
Ns =	3325
K =	36.0 LBS/FT
K(Bal.)=	N/A
Bowl O.D.	18.94"
Bowl Lateral	0.88"
Max. PSI	380
Min. Subm	38"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	

GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

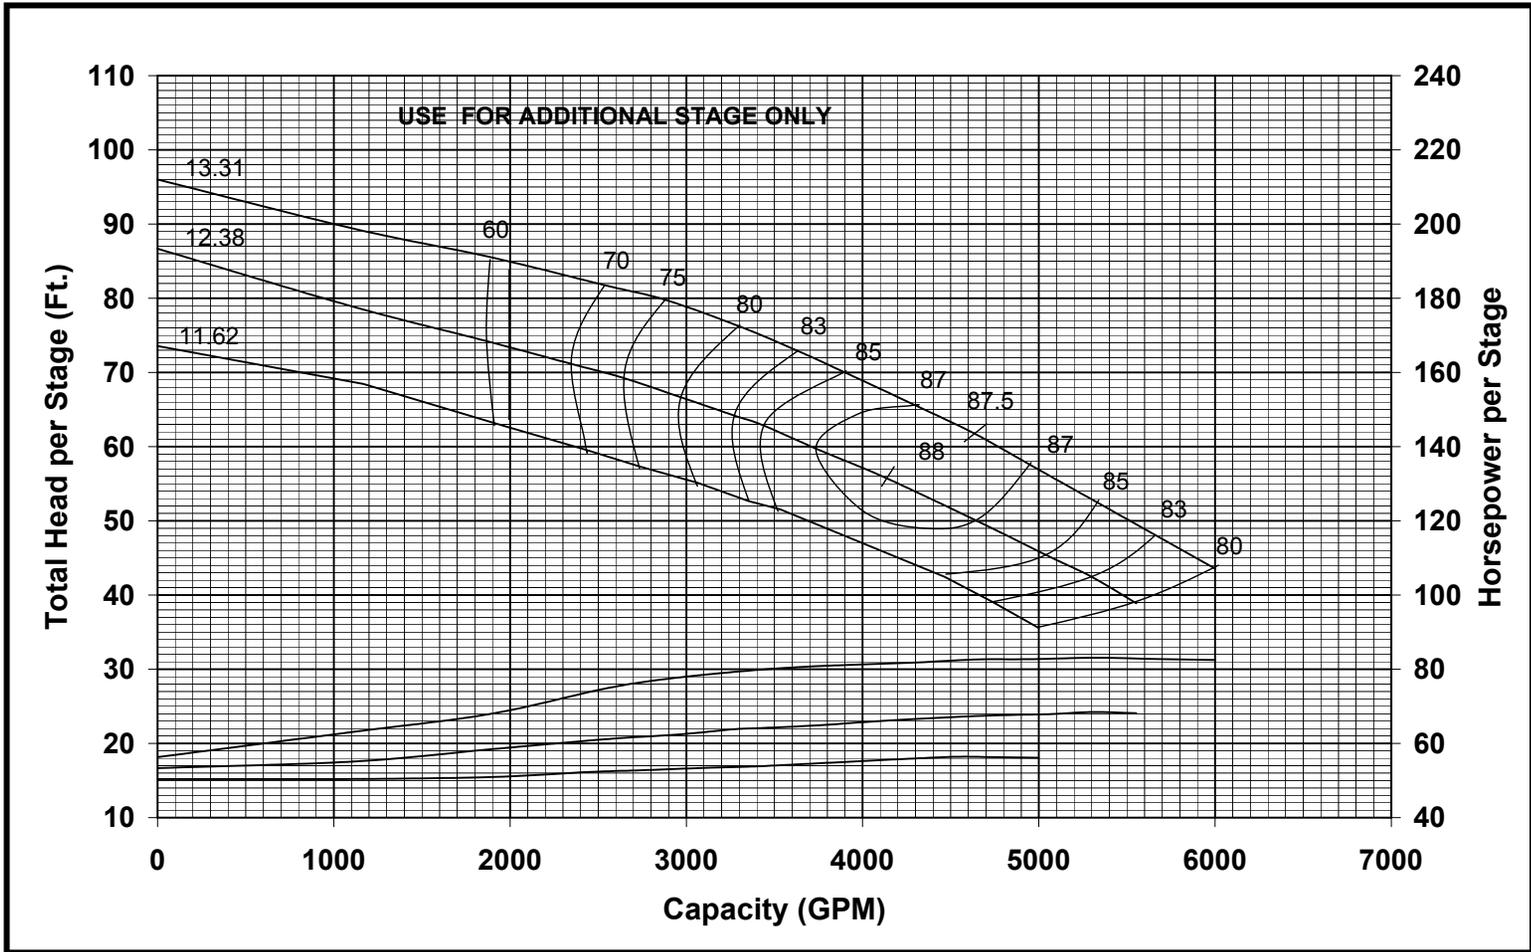

Curve No.	
E6620ECPC2	
Model	20EHC
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
4-STAGE	
Impeller	ENCLOSED
Ns =	3651
K =	30.3 LBS/FT
K(Bal.)=	N/A
Bowl O.D.	18.94"
Bowl Lateral	0.88"
Max. PSI	380
Min. Subm	38"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	