


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

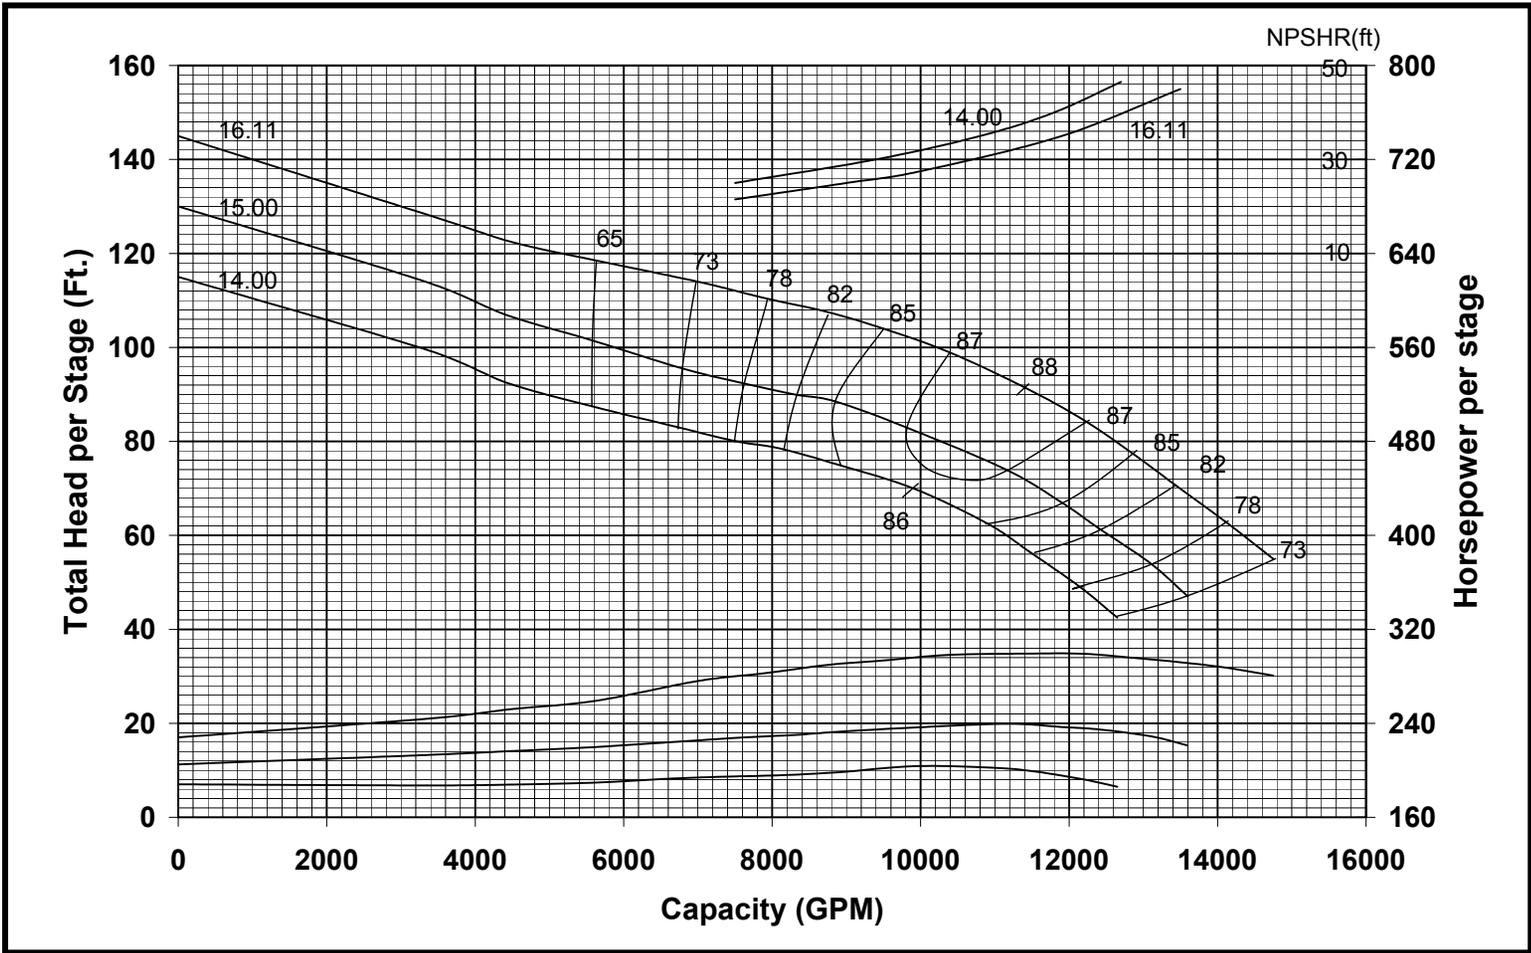

Curve No.	
E6624FAPC2	
Model	24FHC
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	-0.5
2-STAGE	
3-STAGE	
Bal. Imps.	
Impeller	ENCLOSED
Ns =	4270
K =	31.0 LBS/FT
K (Bal.)=	N/A
Bowl O.D.	24.12"
Bowl Lateral	1.43"
Max. PSI	320
Min. Subm	59"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	