



GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

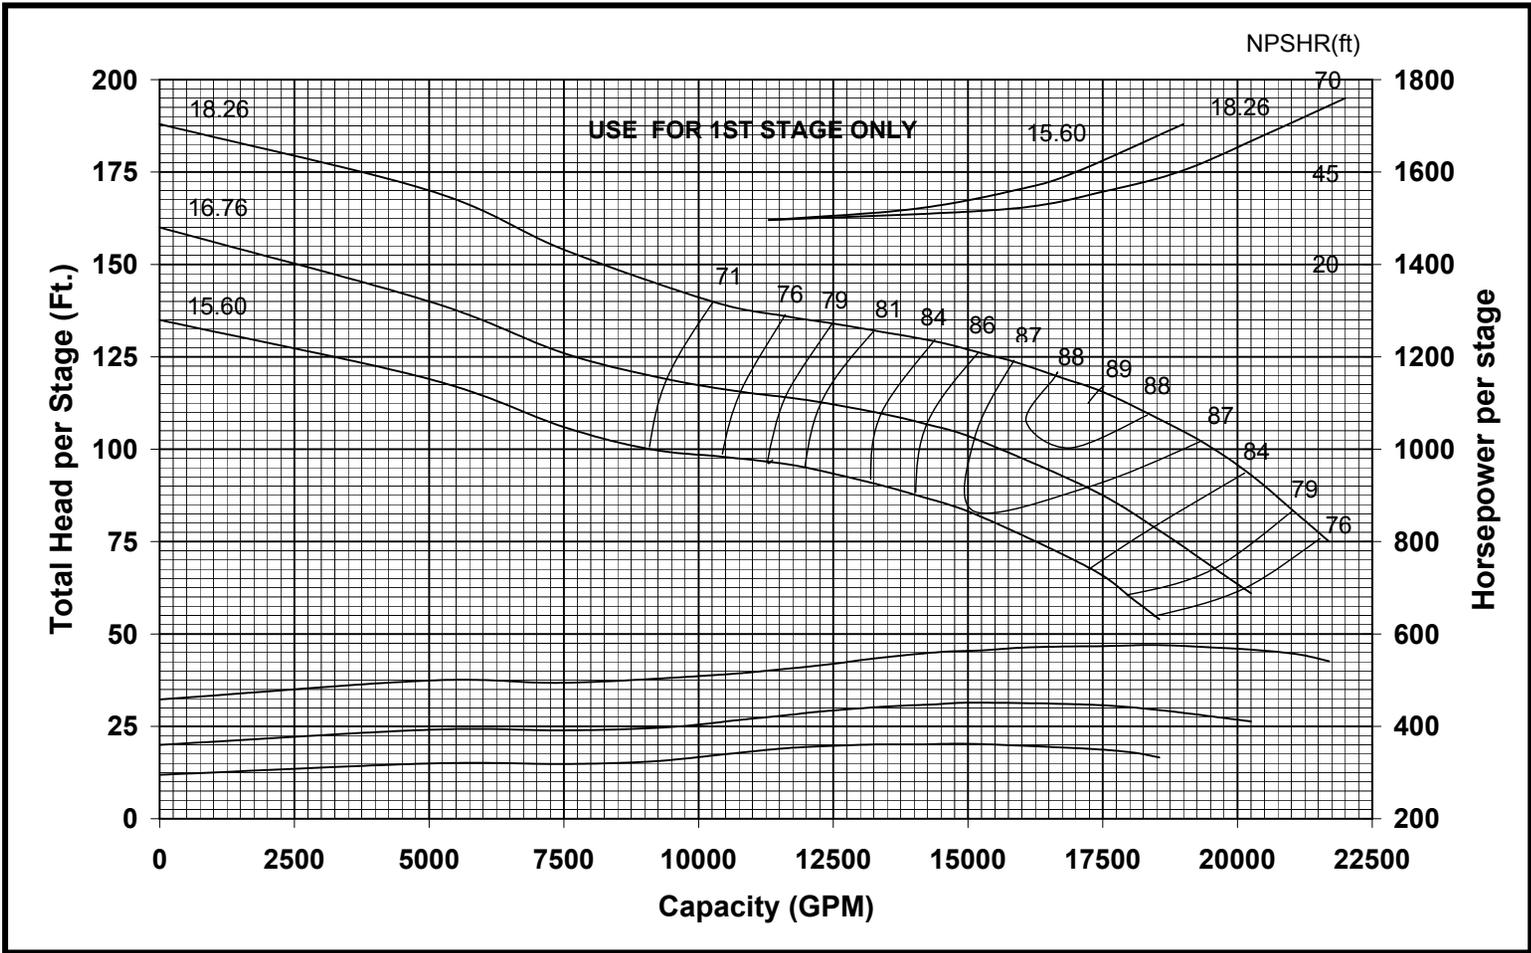

Curve No. E6628GEPF1	
Model	28GHO
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	
Impeller	OPEN
Ns =	4561
K =	96.6 LBS/FT
K (Bal.)=	N/A
Bowl O.D.	26.88"
Bowl Lateral	1.50"
Max. PSI	180
Min. Subm	70"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	

GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

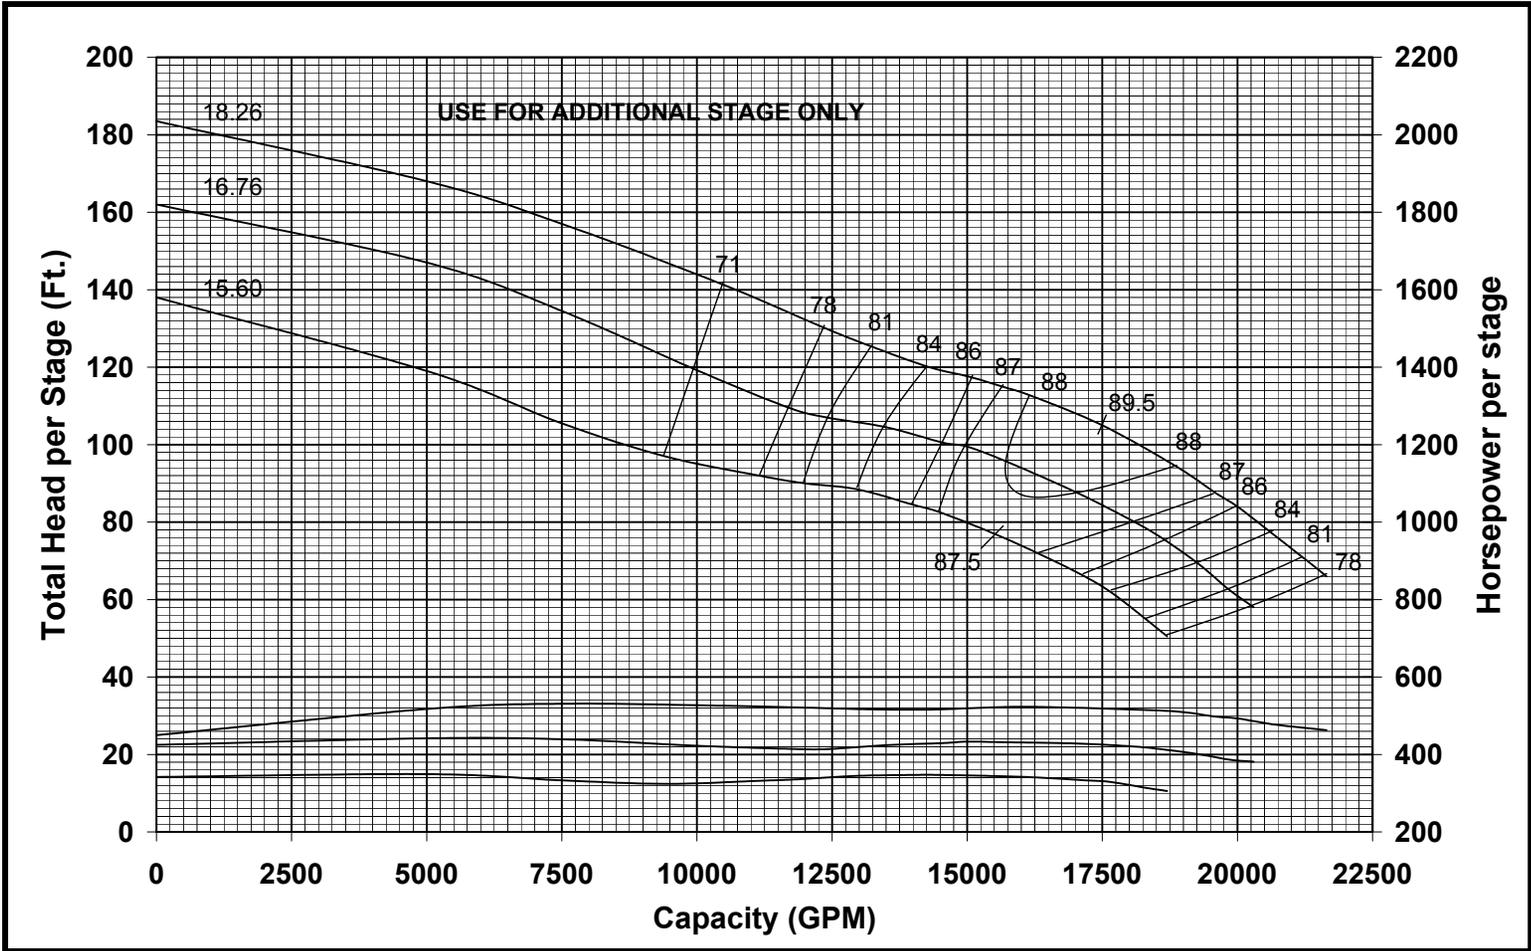

Curve No. E6628GFPF1	
Model	28GHO
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	
Impeller	OPEN
Ns =	4895
K =	96.6 LBS/FT
K (Bal.)=	N/A
Bowl O.D.	26.88"
Bowl Lateral	1.50"
Max. PSI	180
Min. Subm	70"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	