


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

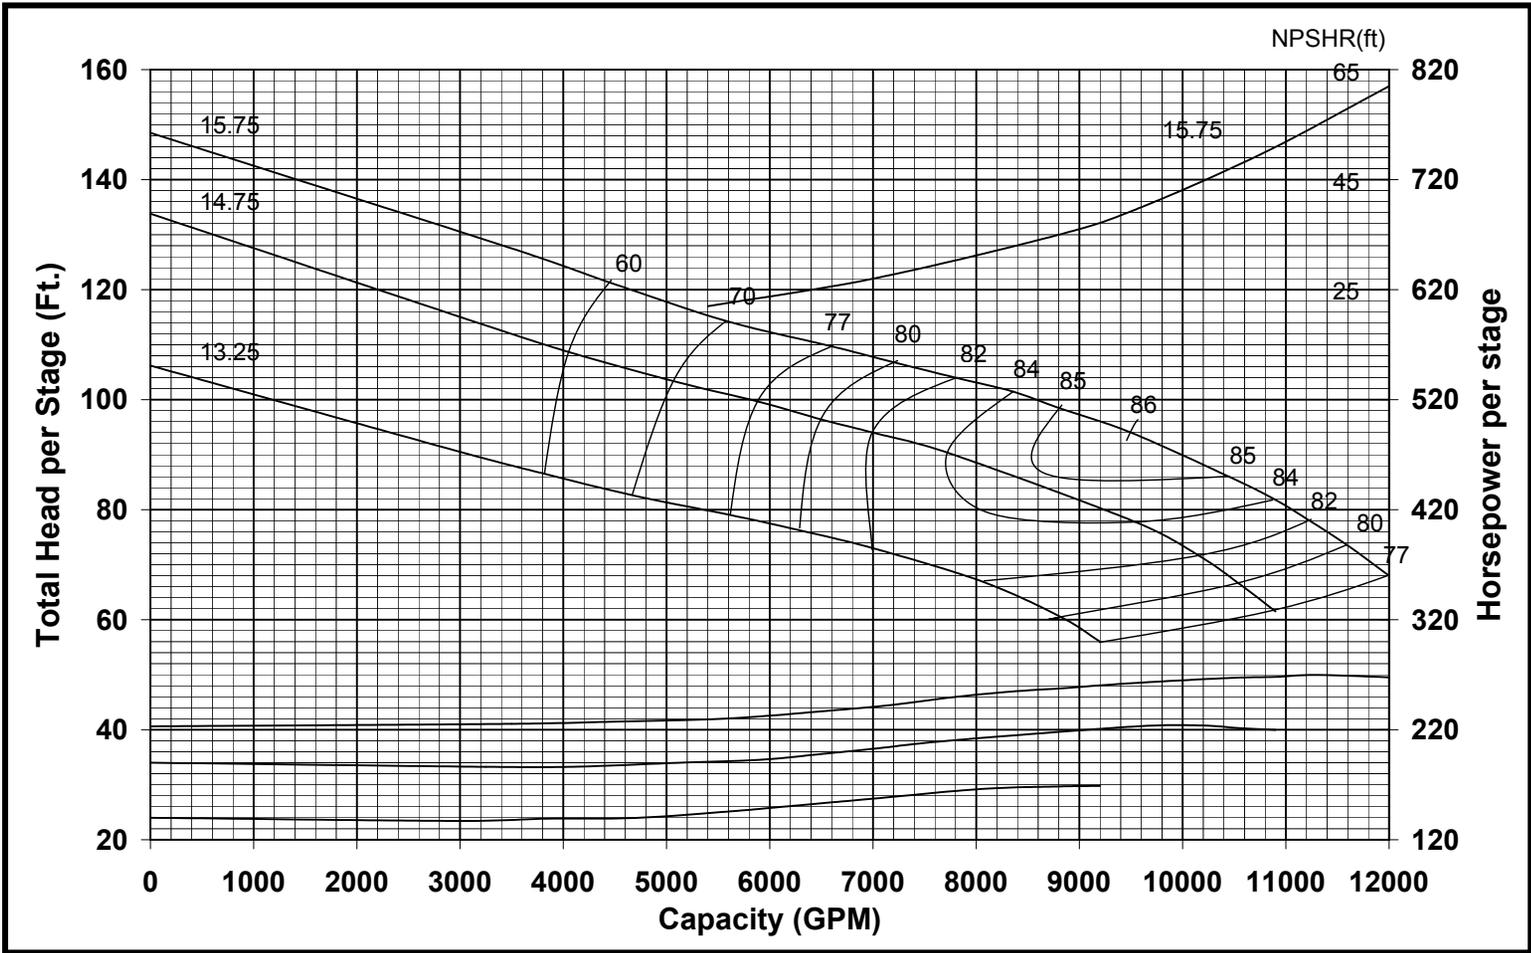

Curve No. E6628TCPC1	
Model 28TMC	
RPM 1180	
EFFICIENCY CORRECTION	
1-STAGE	-1.0
2-STAGE	
3-STAGE	
Bal. Imp.	-2.0
Impeller ENCLOSED	
Ns = 3820	
K = 63.0 LBS/FT	
K (Bal.) = 16.0 LBS/FT	
Bowl O.D.	26.13"
Bowl Lateral	0.87"
Max. PSI	300
Min. Subm	53"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	