


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

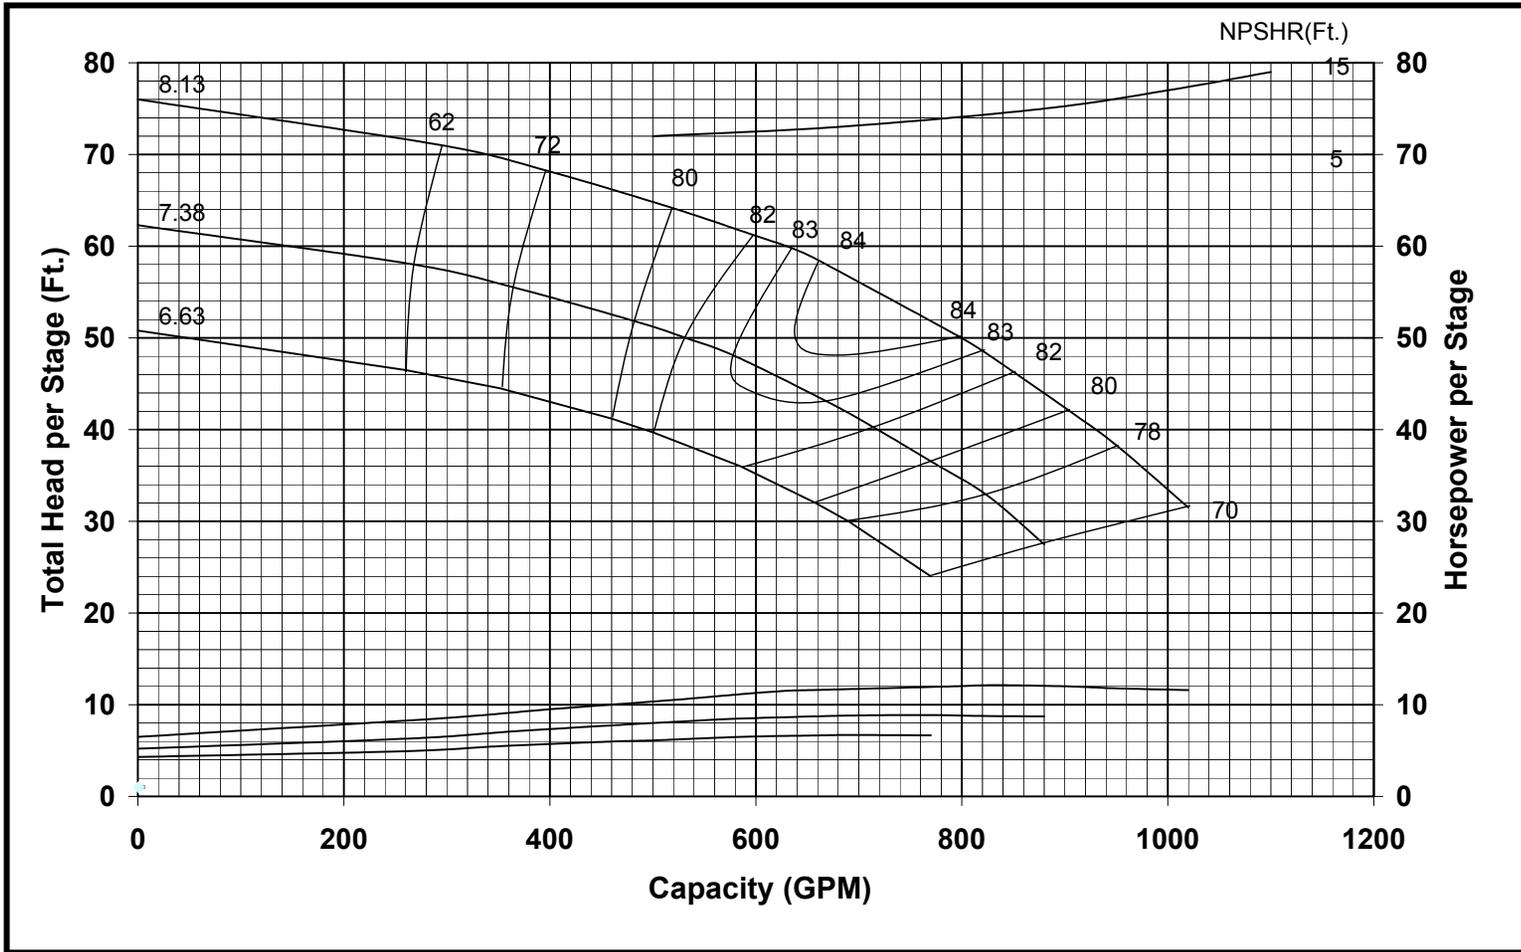

Curve No.	
E6411CJPC1	
Model	11CLO
RPM	1770
EFFICIENCY CORRECTION	
1-STAGE	-1.5
2-STAGE	-1.0
3-STAGE	-0.5
4-STAGE	0.0
Impeller	OPEN
Ns =	2230
K =	9.1 LBS/FT
K(Bal.)=	N/A
Bowl O.D.	11.0"
Bowl Lateral	0.75"
Max. PSI	380
Disch size	6",8",10"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	