


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

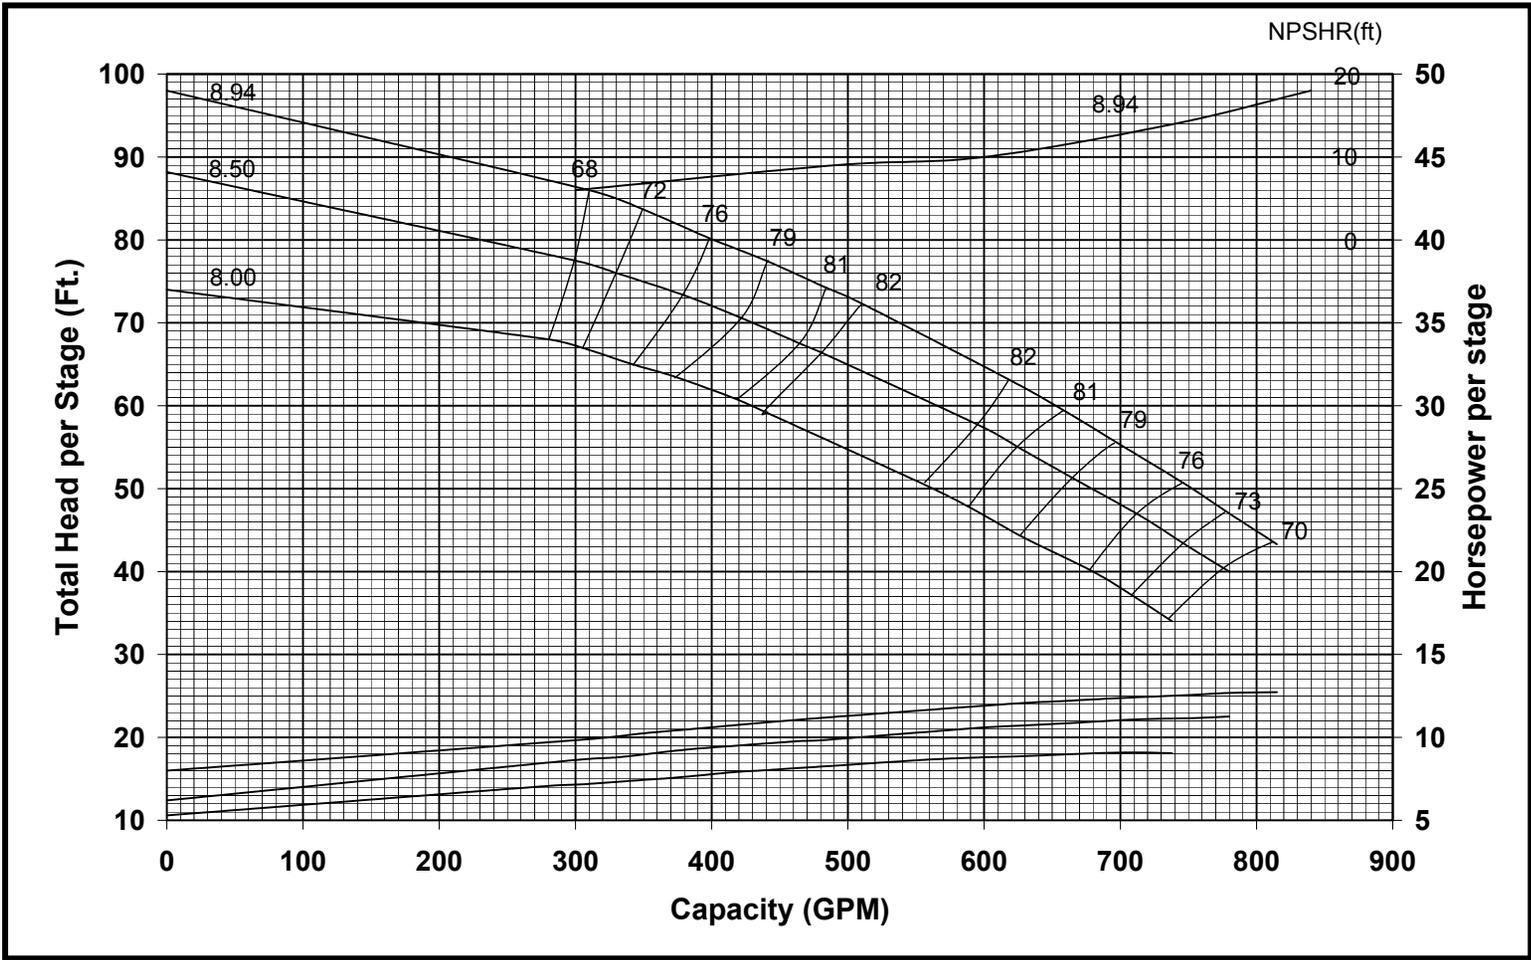

<b>Curve No.</b>	
<b>E6412WBPC1</b>	
<b>Model</b>	<b>12WALC</b>
<b>RPM</b>	<b>1770</b>
<b>EFFICIENCY CORRECTION</b>	
1-STAGE	-3.0
2-STAGE	-2.0
3-STAGE	-1.0
4-STAGE	-0.5
<b>Impeller</b>	<b>ENCLOSED</b>
<b>Ns =</b>	<b>1725</b>
<b>K =</b>	<b>4.60 LBS/FT</b>
<b>K(Bal.)=</b>	<b>N/A</b>
Bowl O.D.	11.60"
Bowl Lateral	0.75"
Max. PSI	390
Disch size	6", 8", 10"
<b>GOULDS PUMPS</b>	
<b>TURBINE OPERATIONS</b>	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	