


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER	
PROJECT	SERVICE			GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

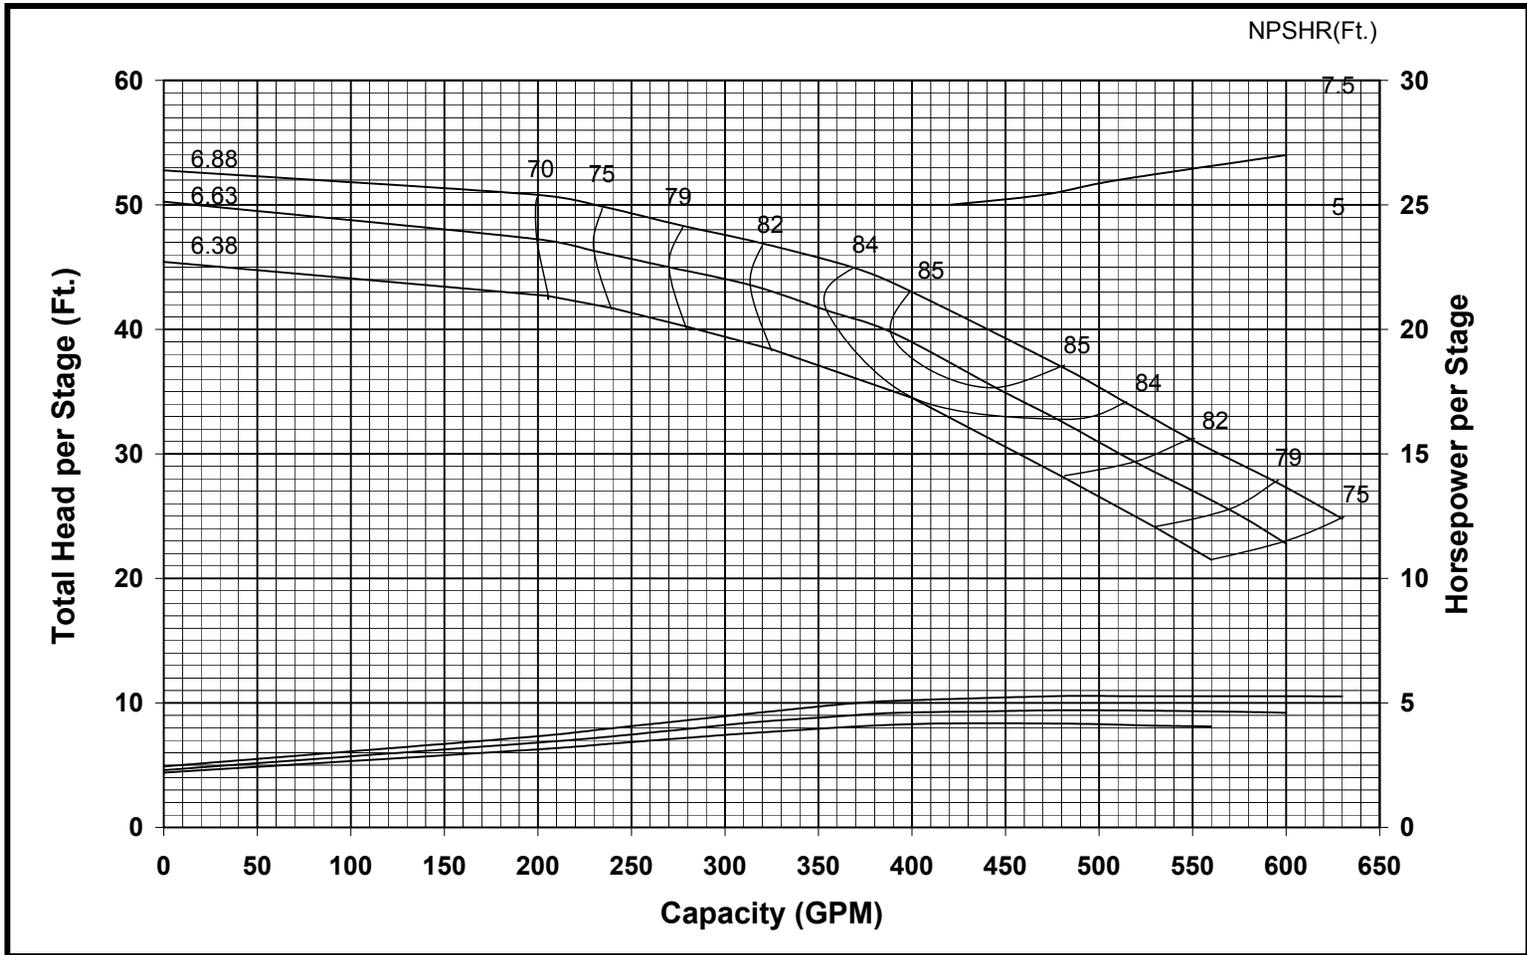

Curve No. E6409CFPC0	
Model 9RCLO	
RPM 1770	
EFFICIENCY CORRECTION	
1-STAGE	-2.0
2-STAGE	-1.0
3-STAGE	-0.5
4-STAGE	0.0
Impeller OPEN	
Ns = 2334	
K = 6.0 LBS/FT	
K(Bal.)= N/A	
Bowl O.D.	9.25"
Bowl Lateral	0.88"
Max. PSI	400
Disch size	5", 6", 8"
GOULDS PUMPS	
TURBINE OPERATIONS Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	