


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT	SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY	RPM

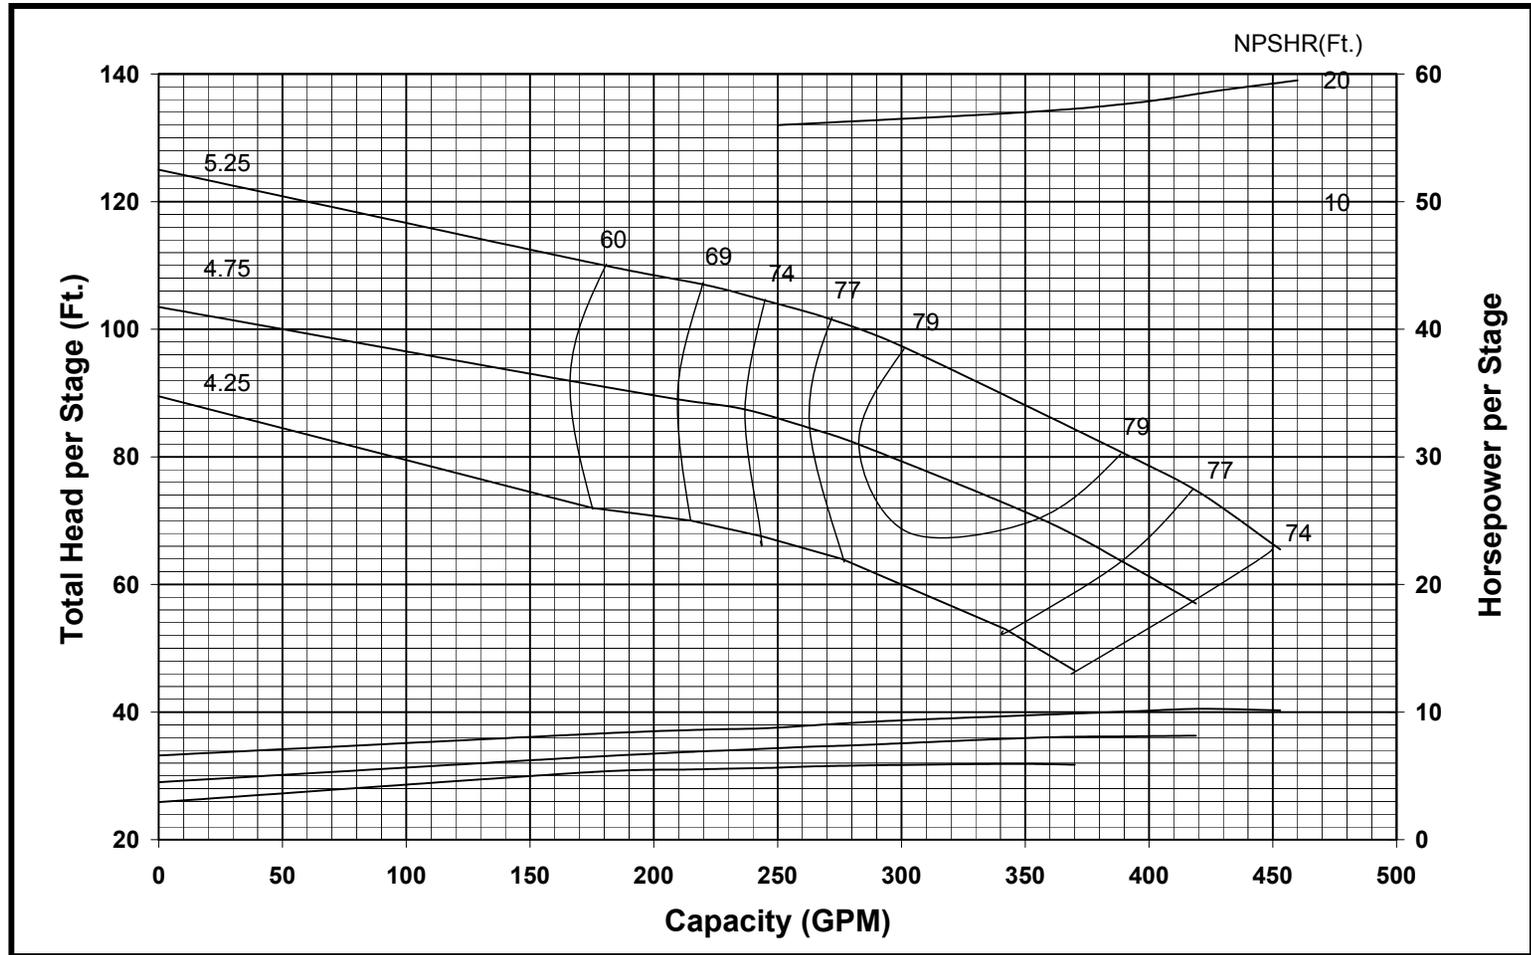

<b>Curve No.</b> <b>E6207CJPC0</b>	
<b>Model</b> 7CLO	
<b>RPM</b> 3450	
EFFICIENCY CORRECTION	
1-STAGE	-2.0
2-STAGE	-1.0
3-STAGE	-0.5
4-STAGE	0.0
Impeller <b>OPEN</b>	
Ns = <b>2160</b>	
K = <b>3.8 LBS/FT</b>	
K(Bal.)= <b>N/A</b>	
Bowl O.D.	7.13"
Bowl Lateral	0.50"
Max. PSI	415
Disch size	4", 5", 6"
<b>GOULDS PUMPS</b>	
<b>TURBINE OPERATIONS</b> Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	