


| | | | | | | |
|---------------------|-----------------|-------------|-------------------|-----------|--------------|----------|
| GOULDS PROPOSAL NO. | GOULDS S.O. NO. | INQUIRY NO. | CUSTOMER P.O. NO. | P.O. DATE | ITEM NO. | CUSTOMER |
| PROJECT | SERVICE | | GPM CAPACITY | FT. TDH | % EFFICIENCY | RPM |

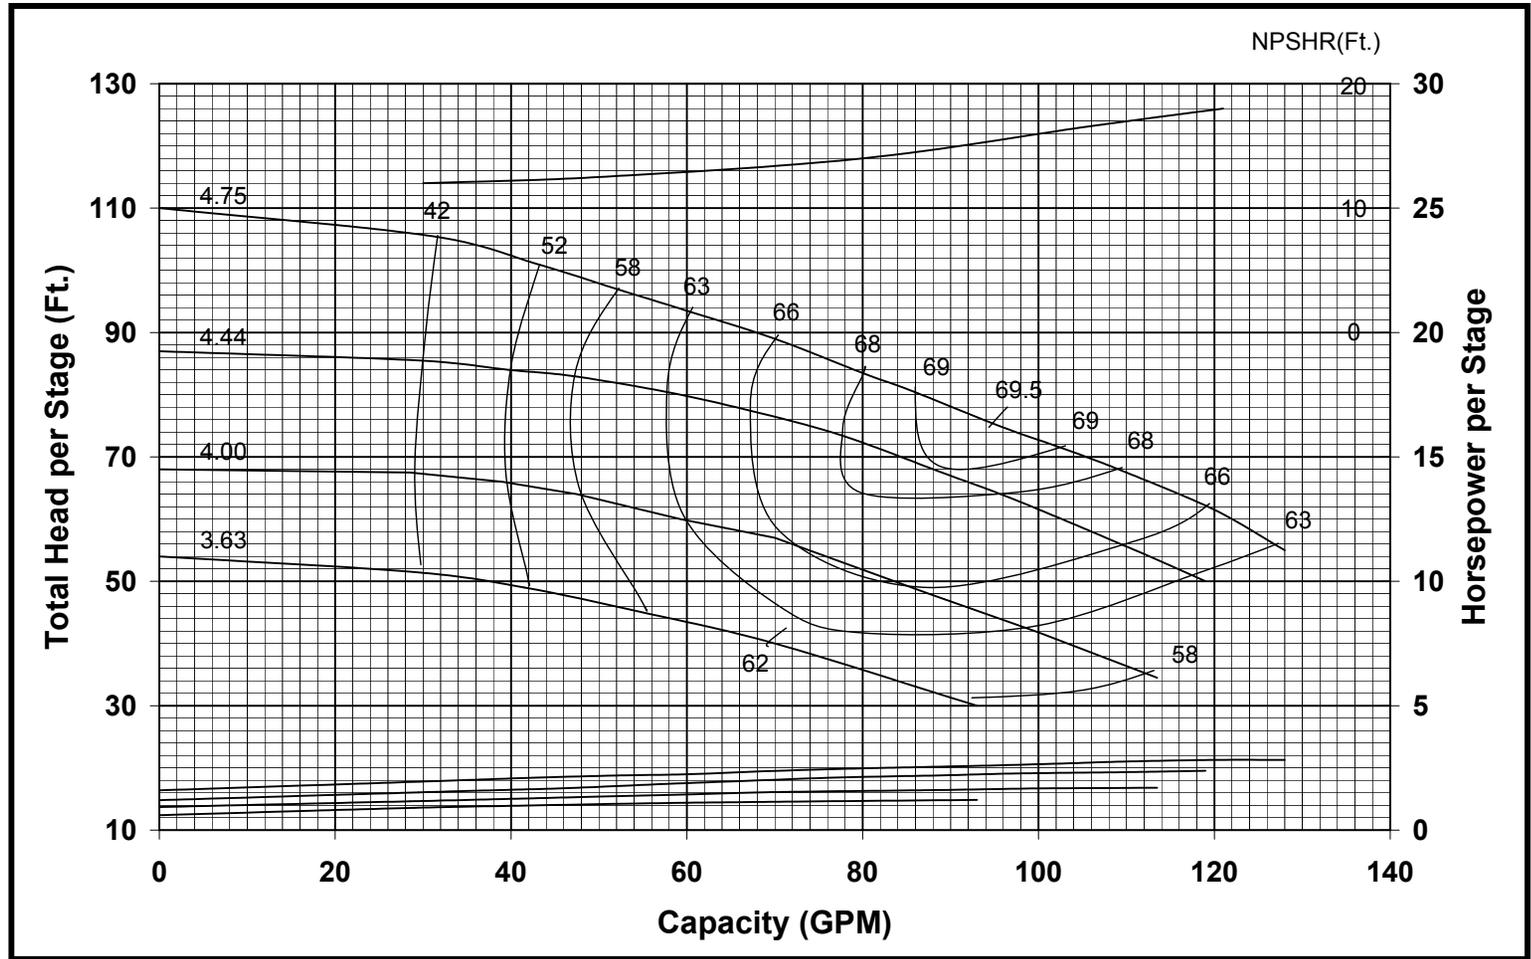

| | |
|--|--------------------|
| Curve No. | |
| E6207ACPC4 | |
| Model | 7RALC |
| RPM | 3550 |
| EFFICIENCY CORRECTION | |
| 1-STAGE | -4.0 |
| 2-STAGE | -2.0 |
| 3-STAGE | -1.0 |
| 4-STAGE | 0.0 |
| Impeller | ENCLOSED |
| Ns = | 1325 |
| K = | 1.61 LBS/FT |
| K(Bal.)= | N/A |
| Bowl O.D. | 7.50" |
| Bowl Lateral | 0.25" |
| Max. PSI | 430 |
| Disch size | 3", 4" |
| GOULDS PUMPS | |
| TURBINE OPERATIONS | |
| Lubbock, Texas | |
| BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES. | |