INGERSOLL RAND PUMPS

VERTICAL PUMPS

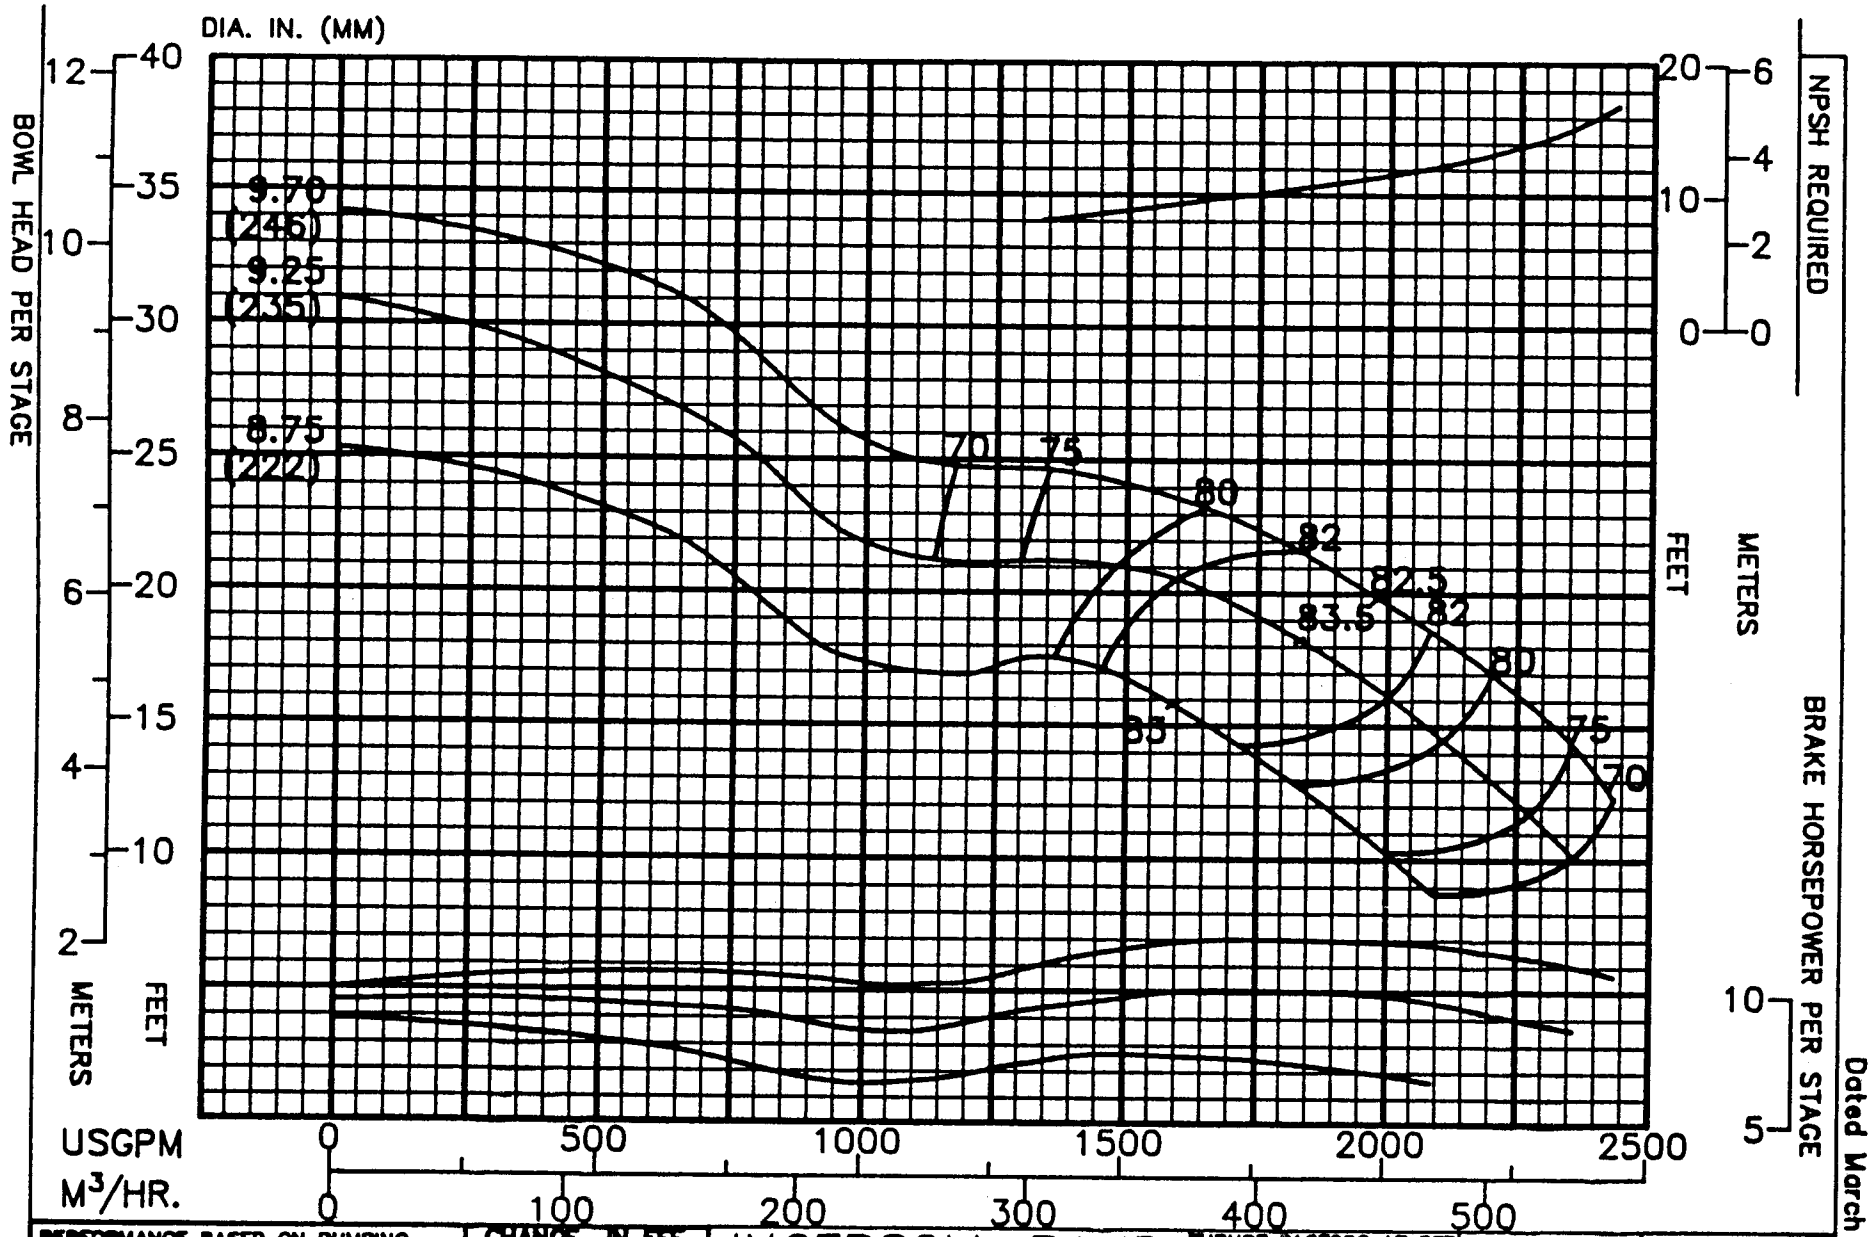

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS
BOWL – CAST IRON – LINED	1	-3
IMPELLER – BRONZE	2	-1
	3	0

INGERSOLL-RAND PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	14.0	20.9
BALANCED	----	----
EYE AREA–37.8 SQ. IN.		

RPM	PUMP
1180	12QKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 5590	EC–1848

7155.00
New Sheet
Dated March 19, 1991