APW - VERTICAL PUMPS

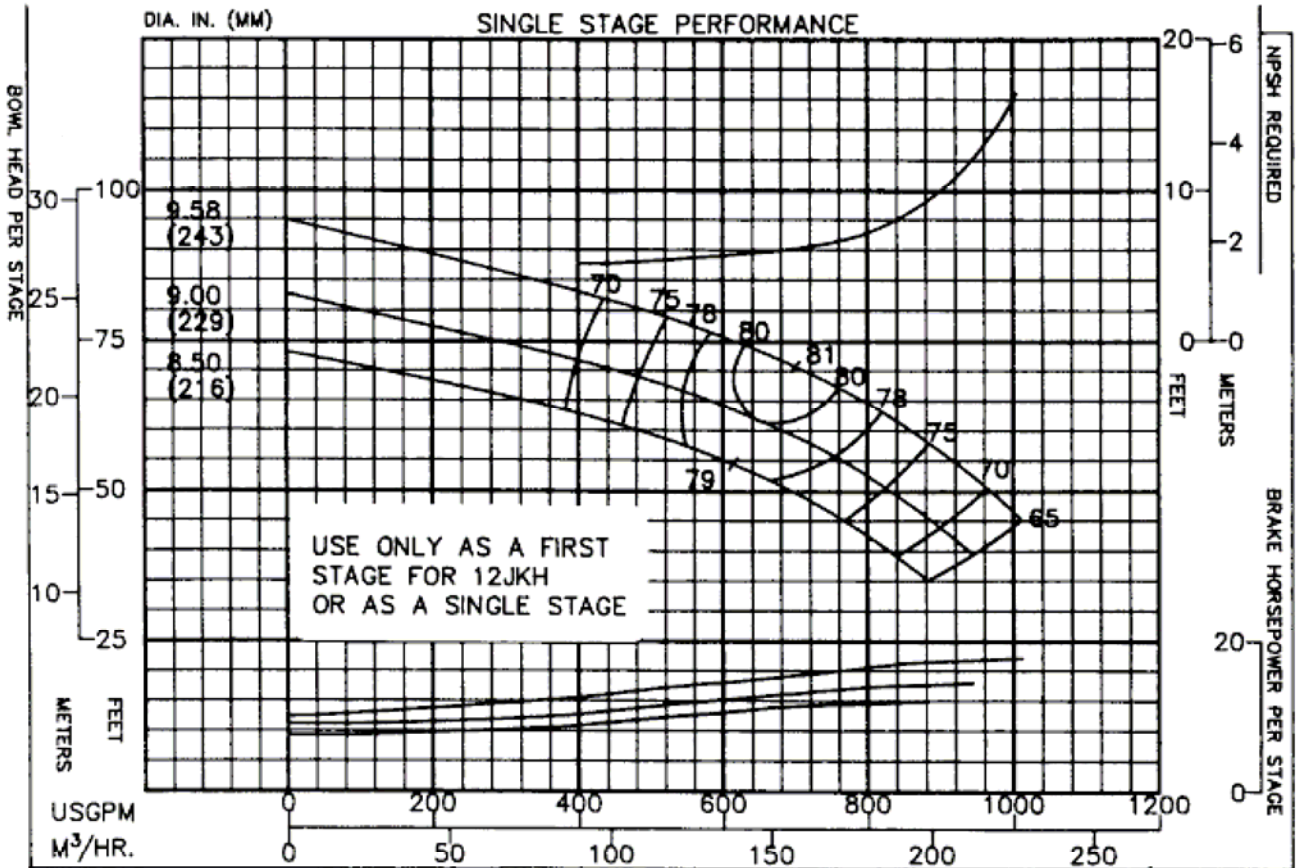

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW BST. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES 1	IN EFF. POINTS 0	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 7.1 10.6; BALANCED -- --; EYE AREA-20.5 SQ. IN.	RPM 1770; ENCLOSED IMPELLER N_s = 1920	PUMP 12JKYH; CURVE NO. EC-1423
BOWL - CAST IRON - LINED						
IMPELLER - BRONZE						