APW - VERTICAL PUMPS

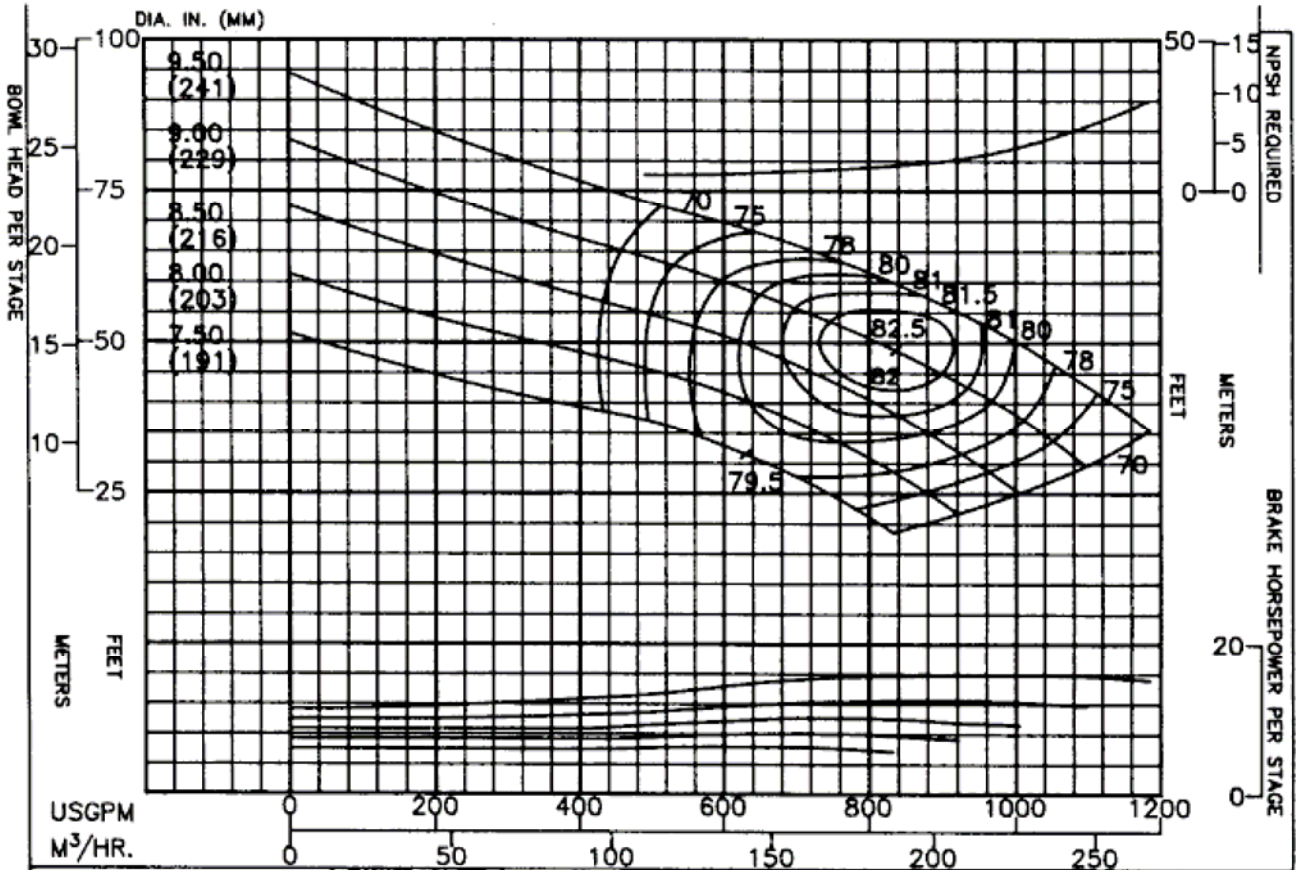

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHARGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT / KG/M; STANDARD 7.40 / 11.0; BALANCED 4.40 / 6.60; EYE AREA-19.0 SQ. IN.	RPM 1770	PUMP 12KKL
BOWL – CAST IRON – LINED	2	-4			ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	3	0			N_s = 2680	EC-1386