APW - VERTICAL PUMPS

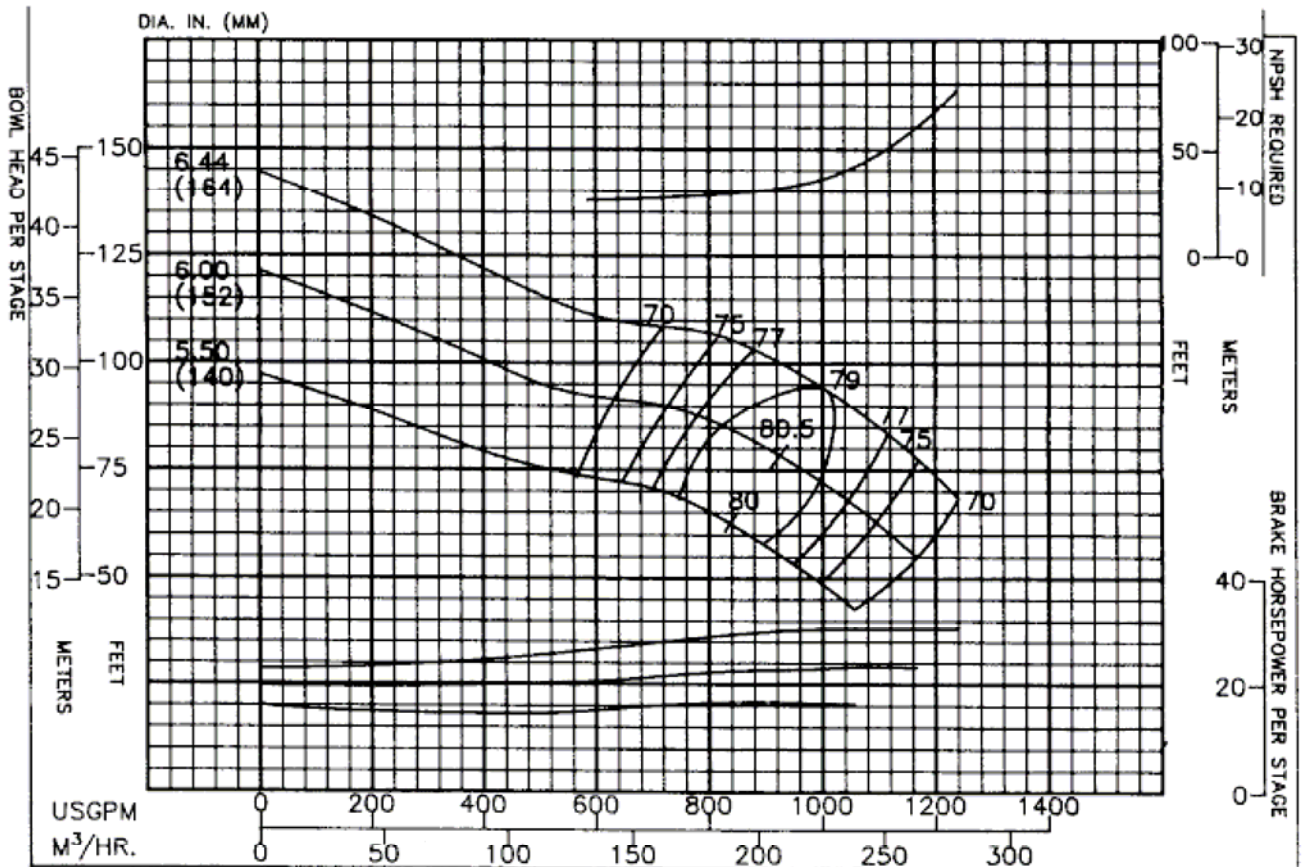

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
	1	-3
	2	-2
BOWL – CAST IRON – LINED	3	-1
IMPELLER – BRONZE	4	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	5.0	7.5
BALANCED	3.1	4.6
EYE AREA–11.3 SQ. IN.		

RPM	PUMP
3550	8NKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 3750	EC–1372