APW - VERTICAL PUMPS

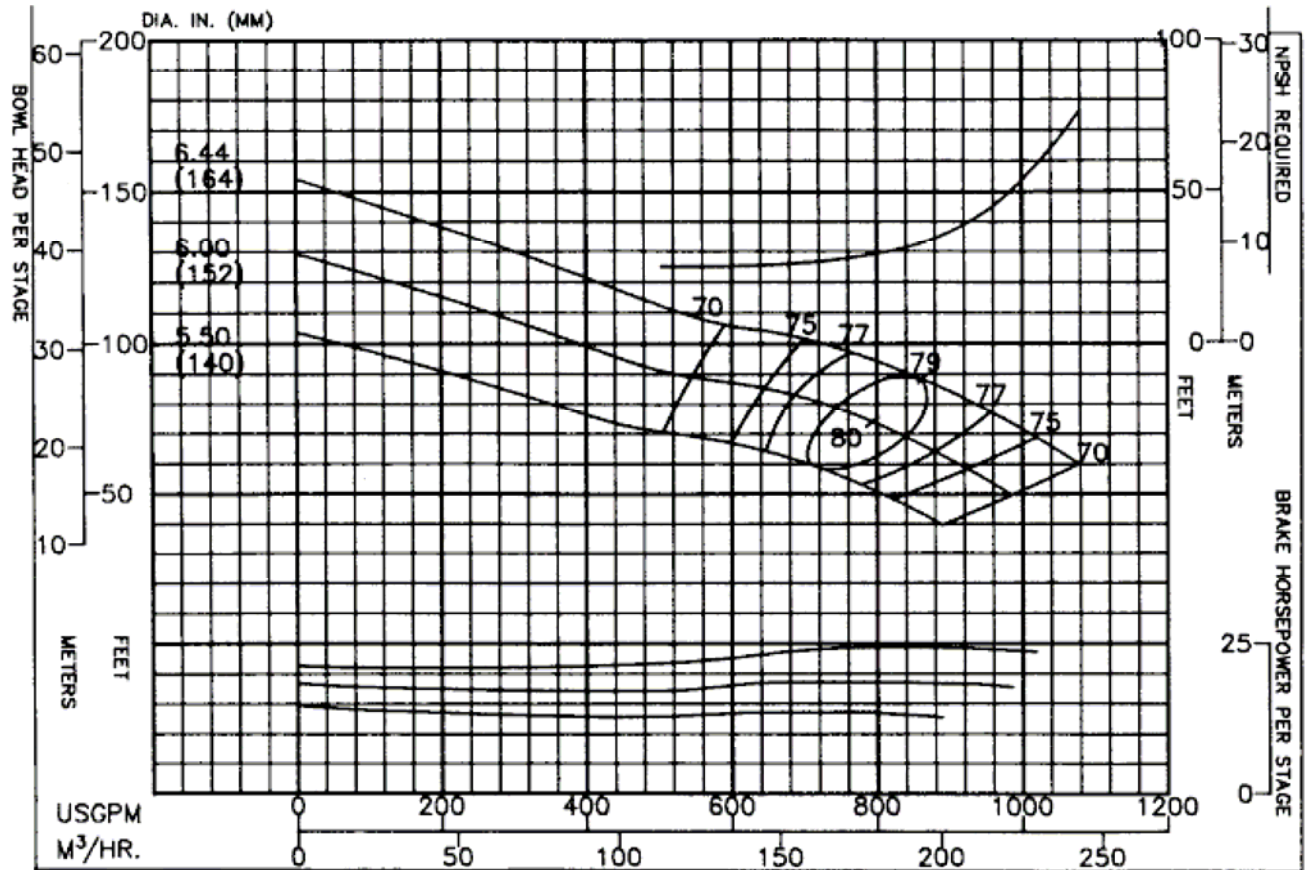

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN FT. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
BOWL – CAST IRON – LINED	1	−3		IMPELLER	LBS/FT	KG/M	3550	8NKL
IMPELLER – BRONZE	2	−2		STANDARD	3.20	7.80	ENCLOSED IMPELLER	CURVE NO.
	3	−1		BALANCED	3.10	4.60	N_s = 3620	EC–1385
	4	0		EYE AREA–11.3 SQ. IN.				