LAYNE & BOWLER, INC.
MEMPHIS, TENN.

DEEP WELL PUMP TEST
PERFORMANCE CHART

TEST NO. 6701
DATE 10/17/61

SIZE DISCHARGE COLUMN 14x2 3/16
SIZE OF SUCTION PIPE 0
LUBRICATION WATER

IMPELLER 8M15
FILING NONE
DIAMETER FULL

PUMP NO. —
ORDER NO X946

FIRST TEST OF 16" EM
INTS - NO ENAMEL
CUSTOMER NO ENAMEL ON INTS
~~SUBSIDIARY~~ INTS - NO FILING

SIZE OF PUMP 16"
TYPE OF PUMP FIGURE EM-MM
NUMBER OF STAGES 2
R.P.M. 1755

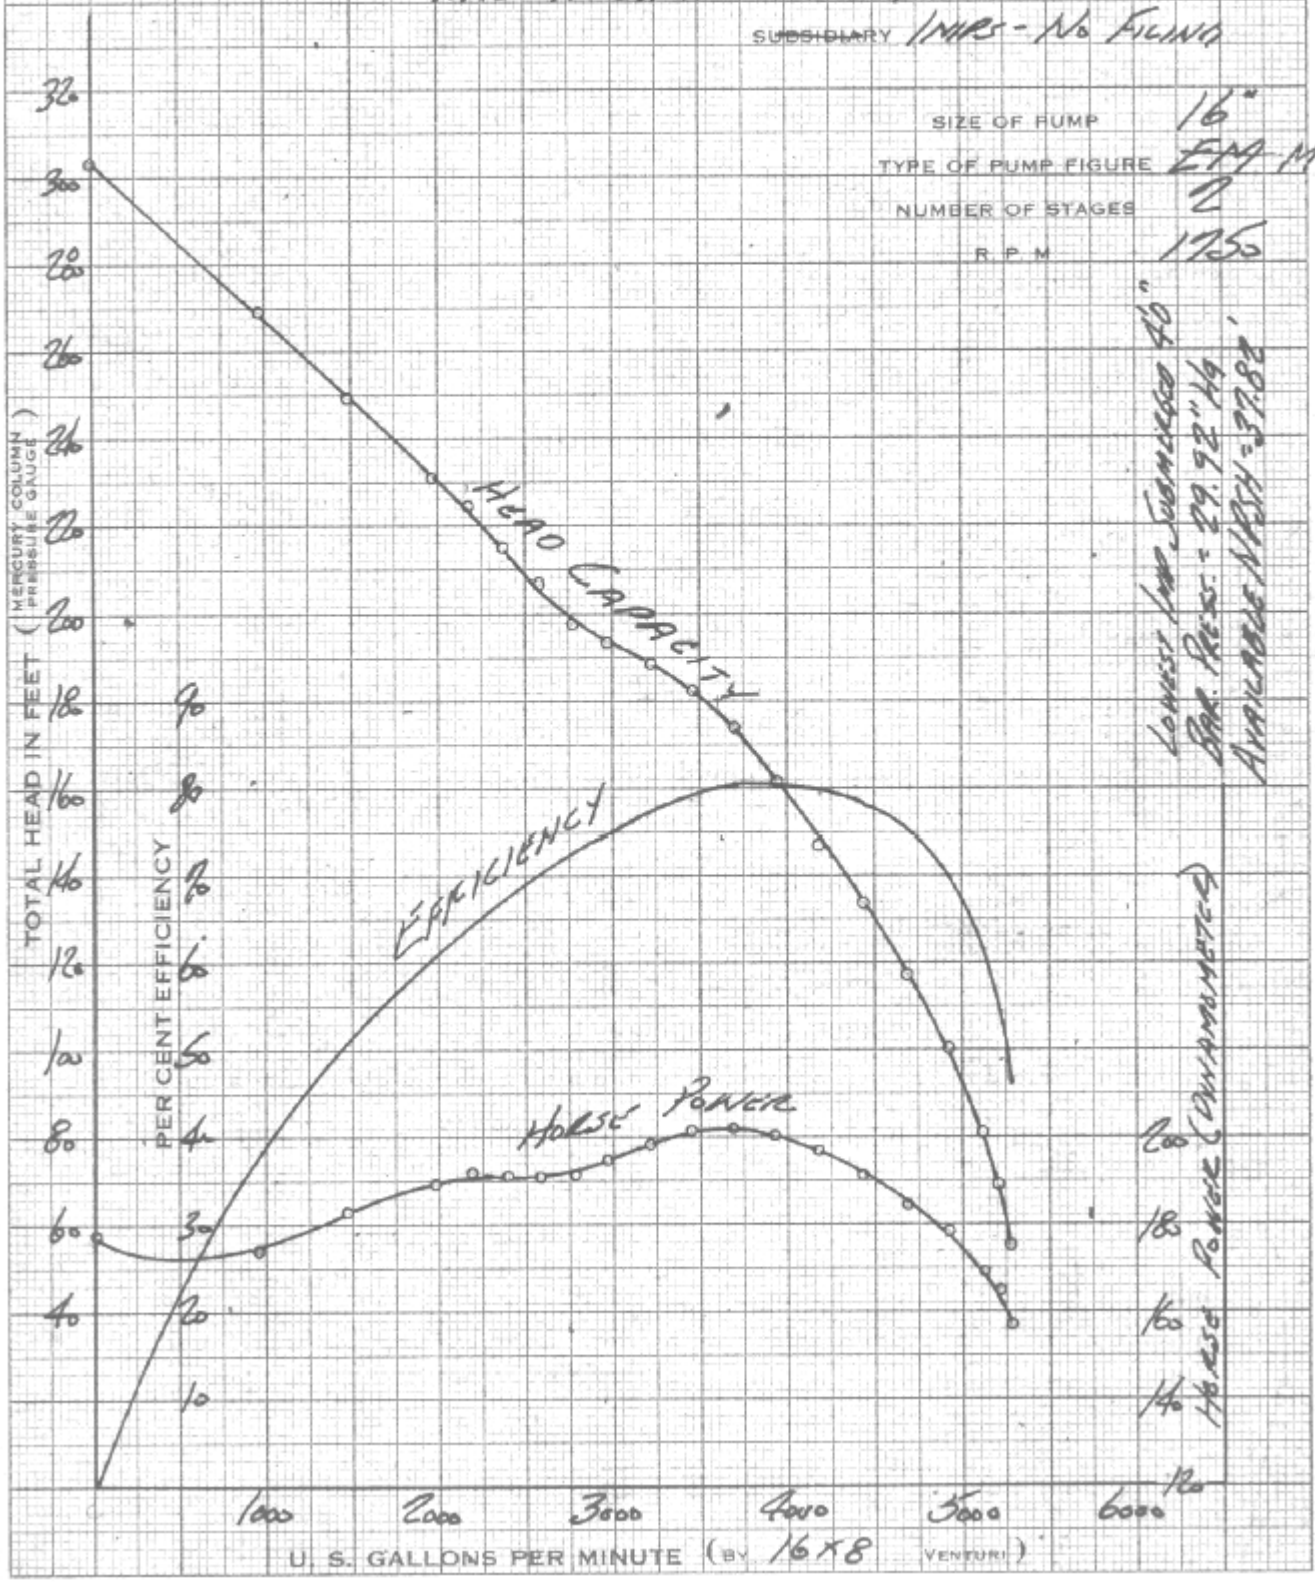

KEUFFEL & ESSER CO. N.Y.