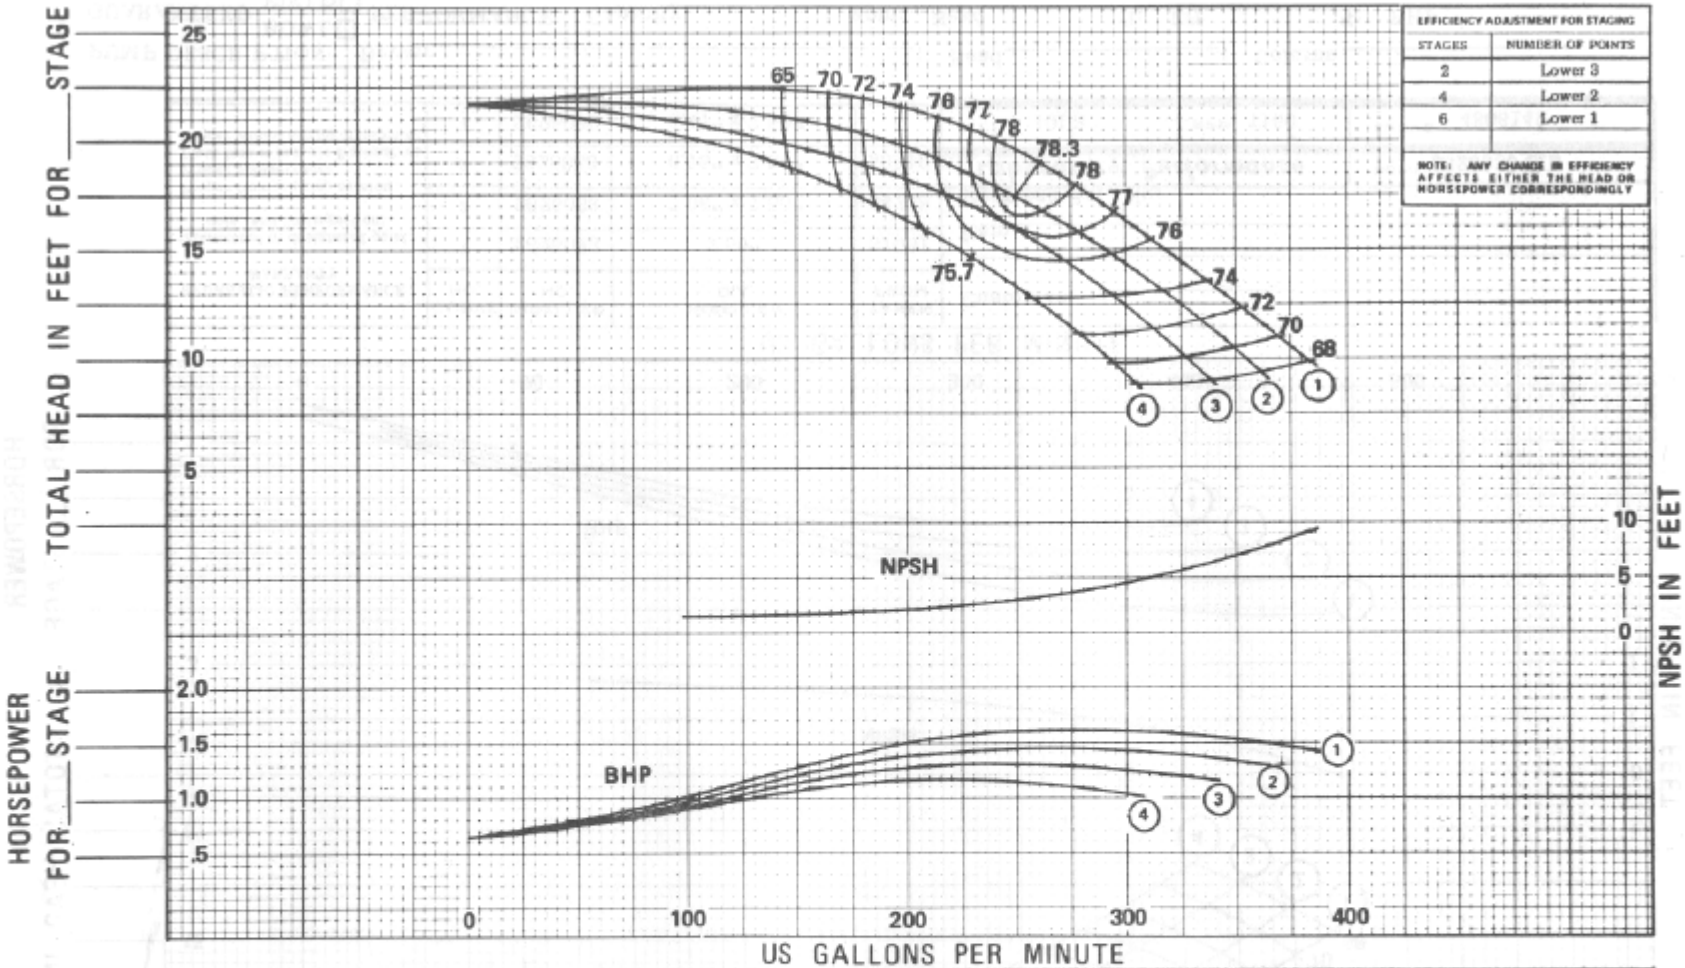

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
2	Lower 3
4	Lower 2
6	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY

Guaranteed at designated point only, and contingent on:

Proper flow to pump suction
Proper submergence
Fluid free of gas, air & abrasives
Proper lateral setting of impeller

CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
1	2625032	7.50"	55500
2	2625032	7.00" x 7.50"	55329
3	2625032	6.84" x 7.50"	55346
4	2625032	6.56" x 7.50"	

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance BOWL 2625030 CIE

SIZE 10LB RPM 1160 CURVE 4806167

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL☐ FIELD☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____