VERTICAL TURBINE PUMPS

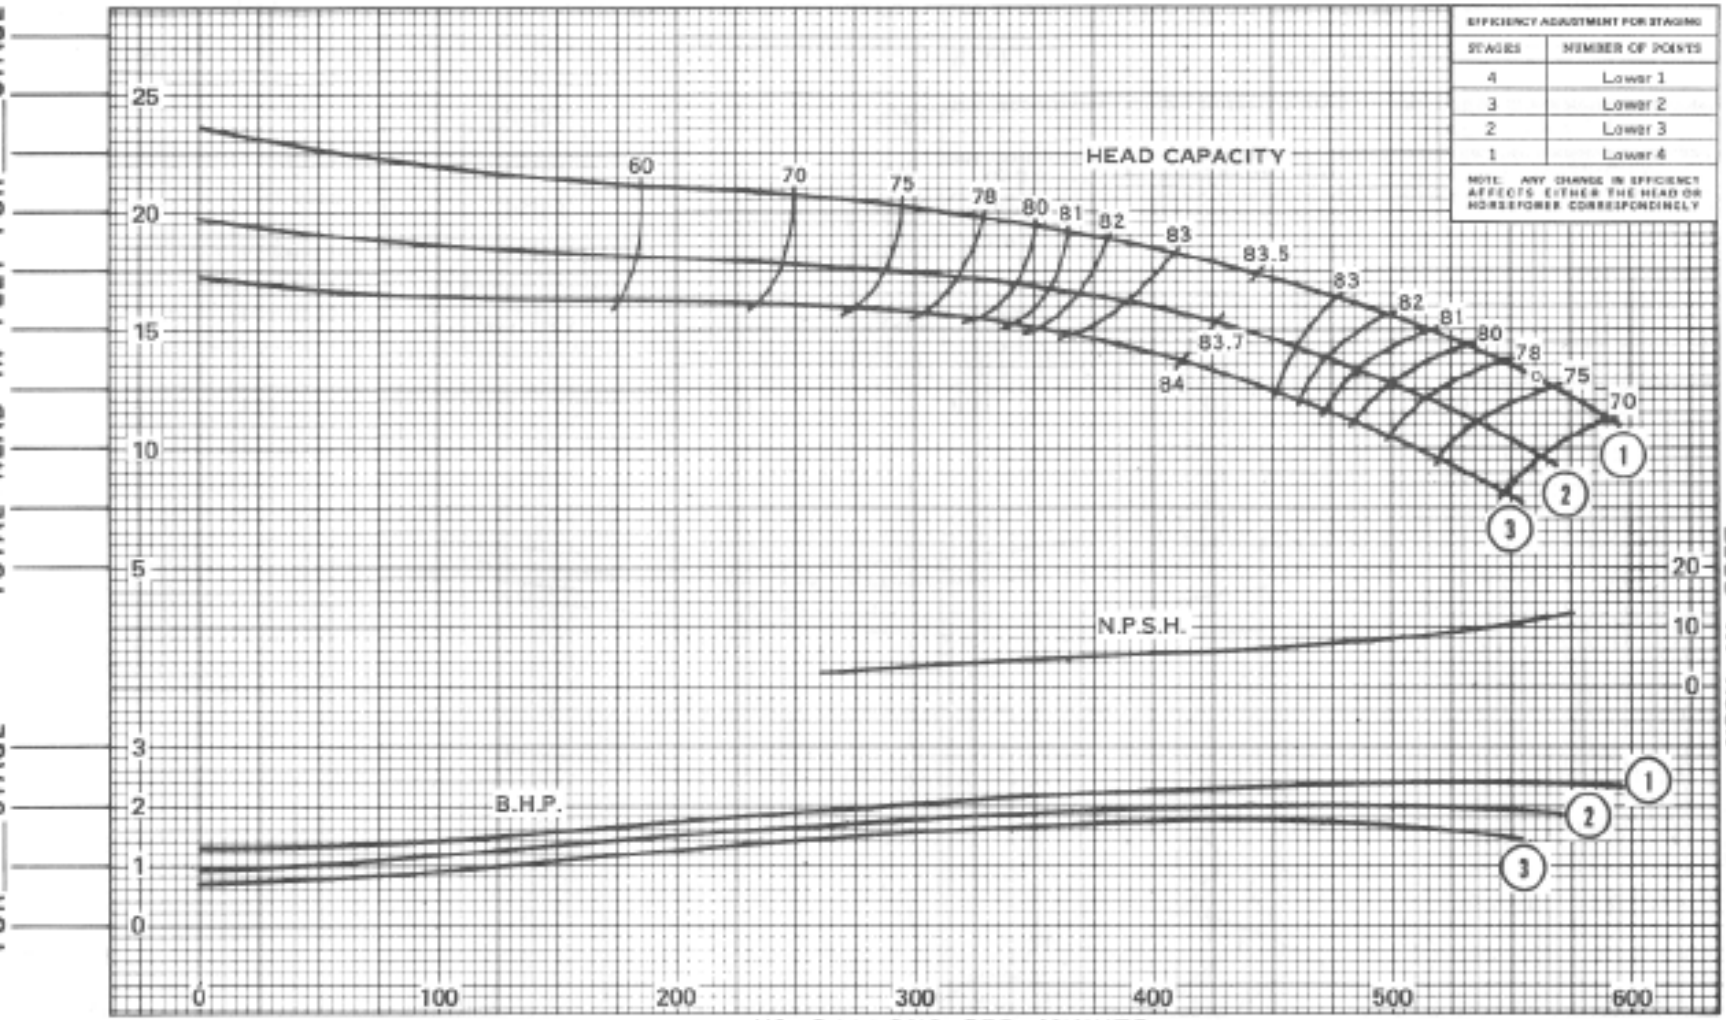

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
4	Lower 1
3	Lower 2
2	Lower 3
1	Lower 4

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on: Proper flow to pump suction; Proper submergence; Fluid free of gas, air & abrasives; Proper lateral setting of impeller	1	2624288	7-1/8"	58416
	2	2624288	6-7/8"	58836
	3	2624288	6-5/8"	58921
	4			

Customer _____

Item _____

Peerless Ref. No: _____

Laboratory Performance — BOWL T-84232-C.I.E.

SIZE 10MA — RPM 1160 — CURVE 4806251

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED PERFORMANCE: BOWL ☐ FIELD ☐ Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____

Peerless Pump
A Sterling Company