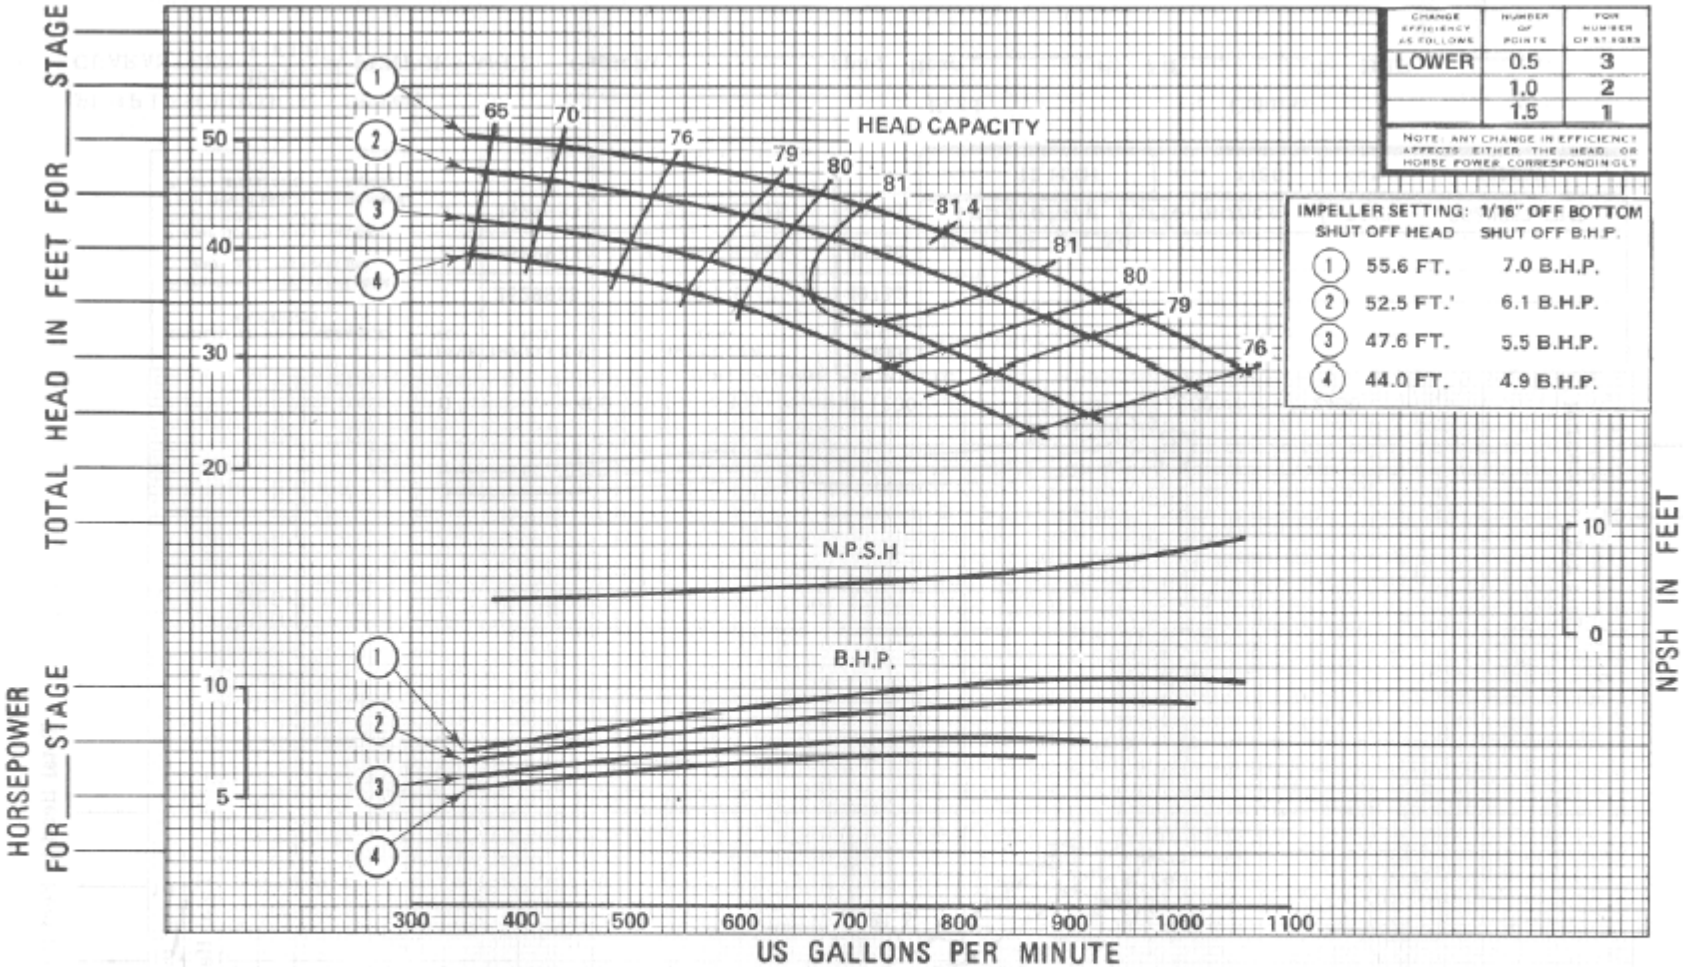

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	0.5	3
	1.0	2
	1.5	1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSE POWER CORRESPONDINGLY

IMPELLER SETTING: 1/16" OFF BOTTOM	SHUT OFF HEAD	SHUT OFF B.H.P.
1	55.6 FT.	7.0 B.H.P.
2	52.5 FT.'	6.1 B.H.P.
3	47.6 FT.	5.5 B.H.P.
4	44.0 FT.	4.9 B.H.P.

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on:	1	2634704	10.1 x 11.1	54870
Proper flow to pump suction	2	2634704	9.88 x 10.88	54933
Proper submergence	3	2634704	9.59 x 10.53	54954
Fluid free of gas, air & abrasives	4	2634704	9.31 x 10.25	55027
Proper lateral setting of impeller				

Customer _____

Item _____

Peerless Ref. No: _____

Laboratory Performance — BOWL 2634706 C.I.E.

SIZE 14LD — RPM 1180 — CURVE 4806001

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL☐ FIELD☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____