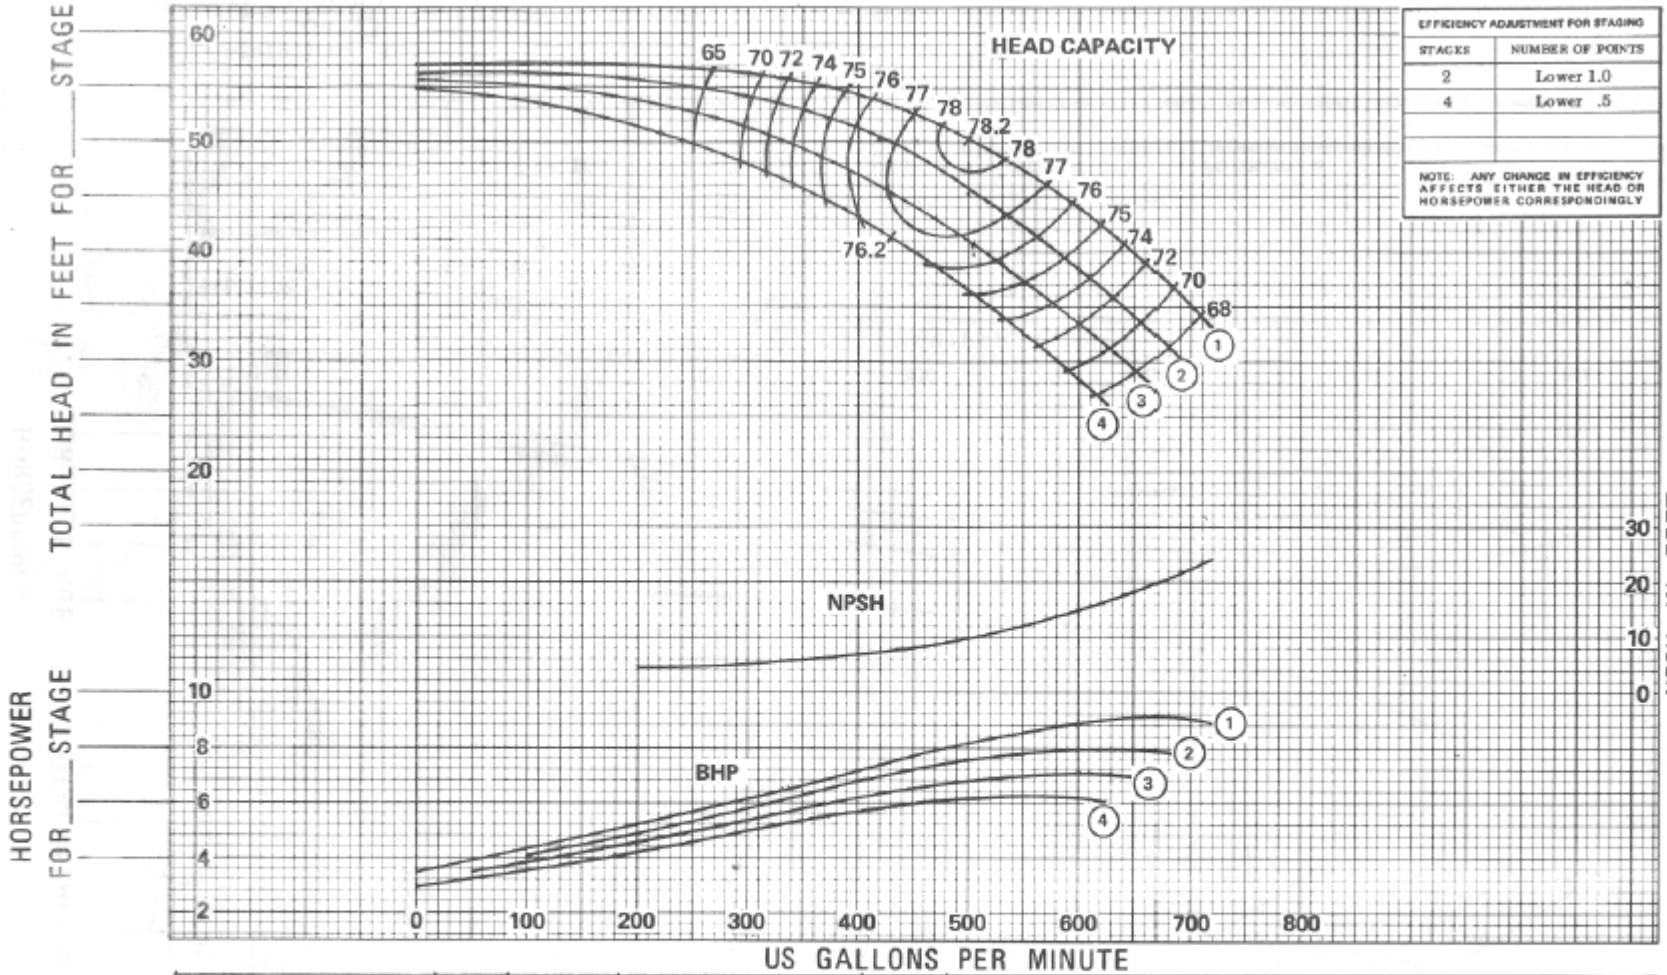

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
2	Lower 1.0
4	Lower .5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on:	1	2625033	7.50"	51001
Proper flow to pump suction	2	2625033	7.06" x 7.50"	54248
Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	3	2625033	6.75" x 7.50"	53810
	4	2625033	6.47" x 7.50"	

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance — BOWL 2625030 CIE

SIZE 10LB — RPM 1760 — CURVE 4806128

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL☐ FIELD☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____