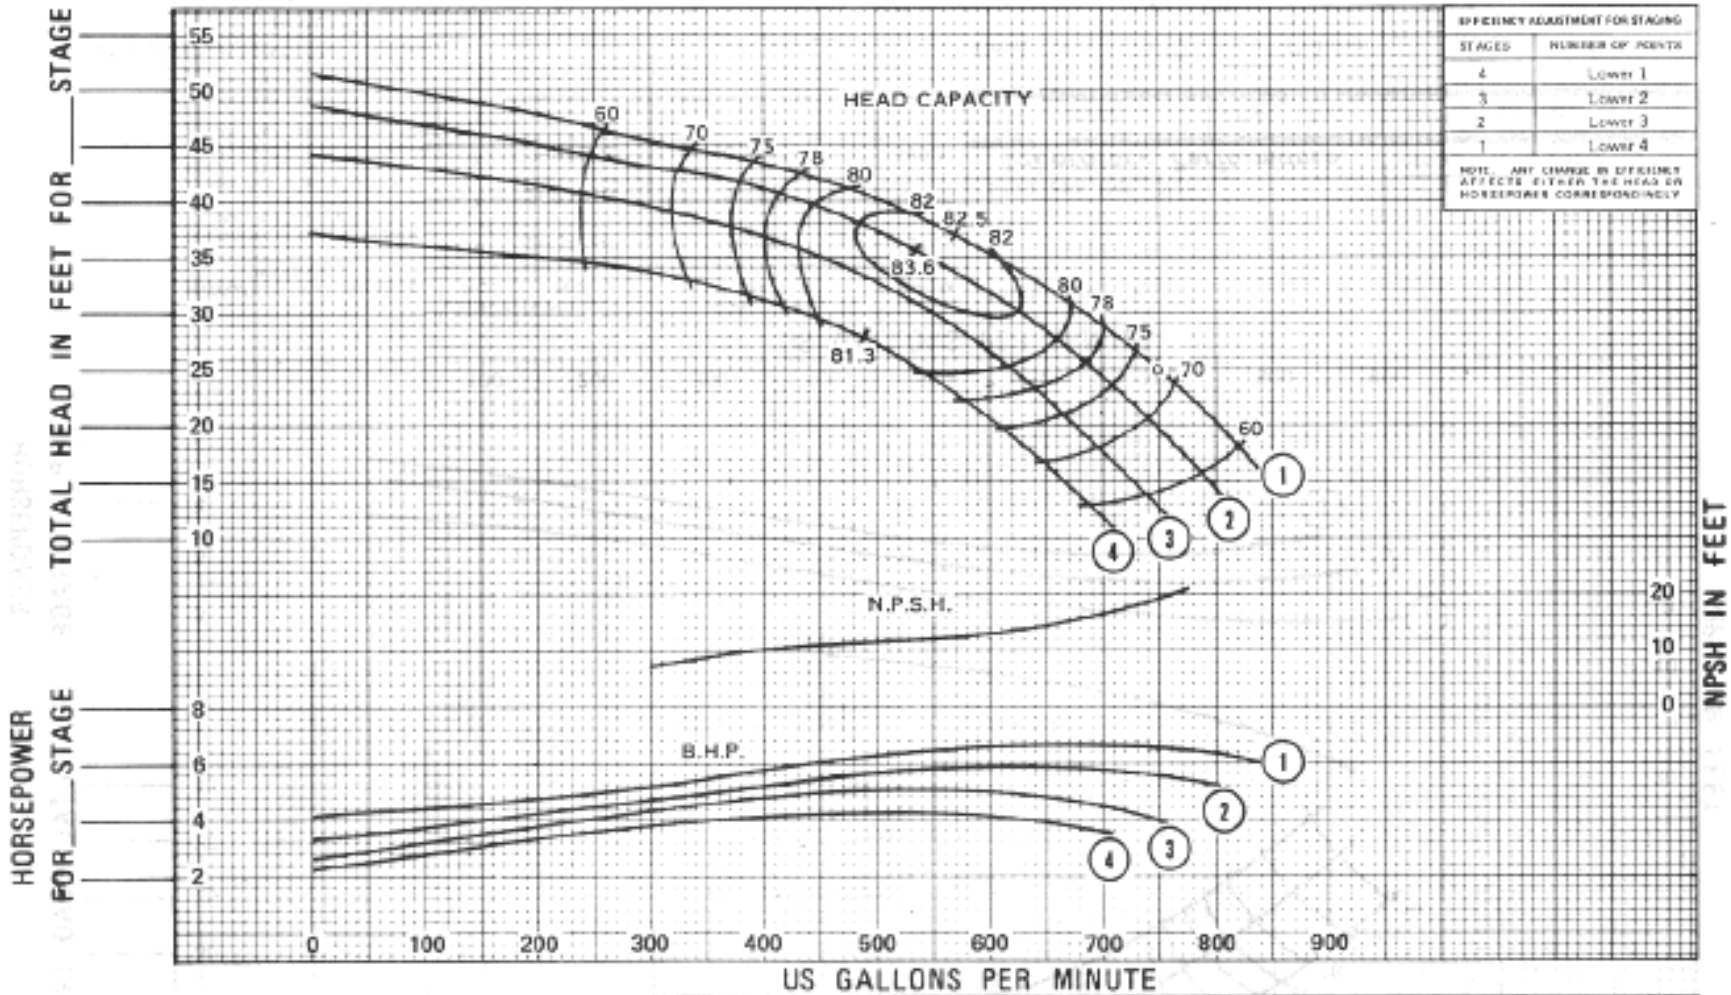

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
4	Lower 1
3	Lower 2
2	Lower 3
1	Lower 4

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on: Proper flow to pump suction, Proper submergence, Fluid free of gas, air & abrasives, Proper lateral setting of impeller	1	T84363	UNDERCUT 7-1/8"	58076
	2	T84363	STANDARD FILING 7-1/8"	58356
	3	T84363	7"	____
	4	T84363	6-5/8"	26863

Customer _____

Item _____

Peerless Ref. No: _____

Laboratory Performance — BOWL T-84232-C.I.E.

SIZE 10MA — RPM 1760 — CURVE 4806183

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL☐ FIELD☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____