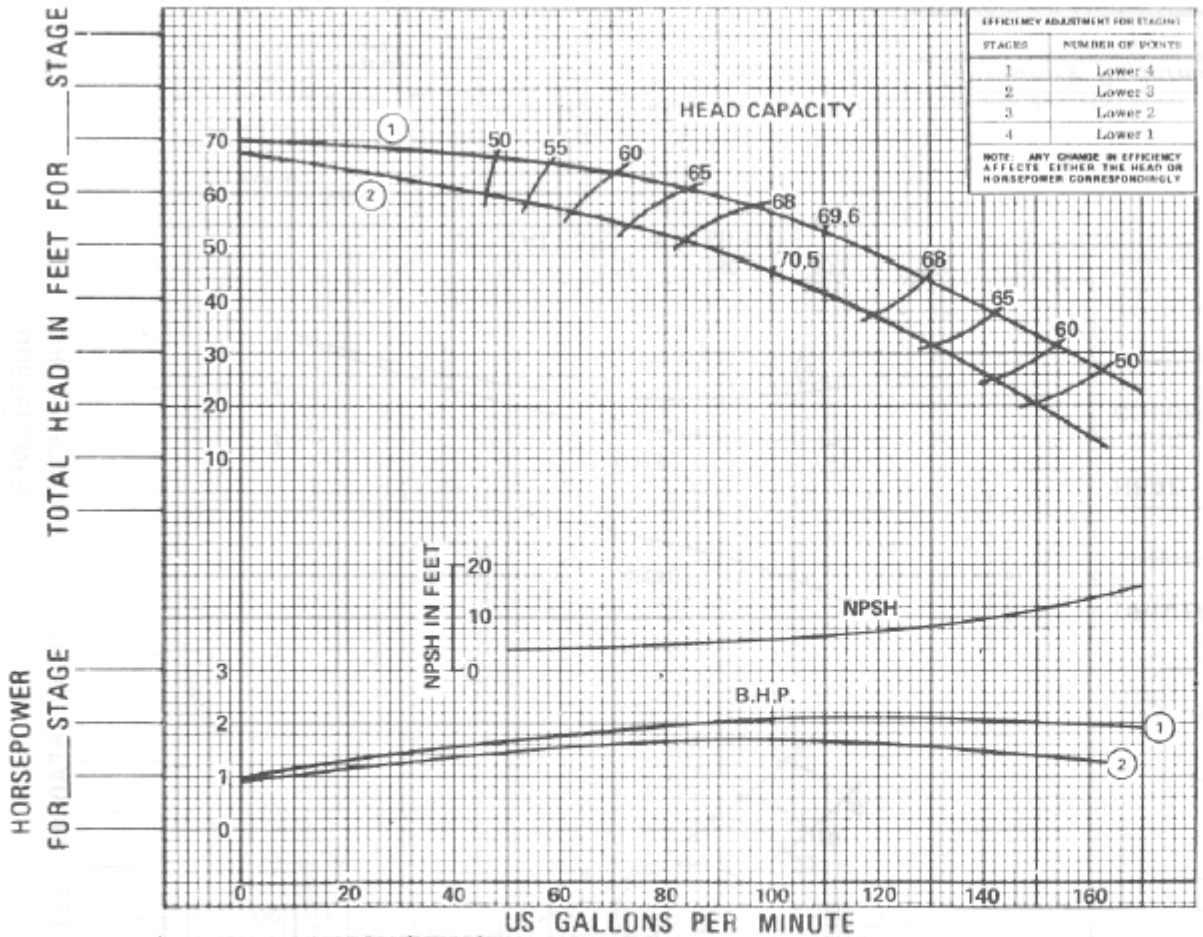

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 4
2	Lower 3
3	Lower 2
4	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

2 POLE 60 HERTZ PERFORMANCE

GUARANTEED PERFORMANCE

◯ Bowl

◯ Field

Capacity _____ gpm

Head _____ Feet

BHP _____

EFFICIENCY _____ %

DRIVER

_____

_____

HEAD

_____

COLUMN

_____

_____

_____

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA	TAKEN FROM
Guaranteed at designated point only, and contingent on:	1	2616324	4-15/32	55324
Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	2	2616324	4-1/32 x 4-15/32	55529
	3			
	4			

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance					
SIZE	6LB	RPM	3460	CURVE	4806259
				BOWL	2616320 CIE