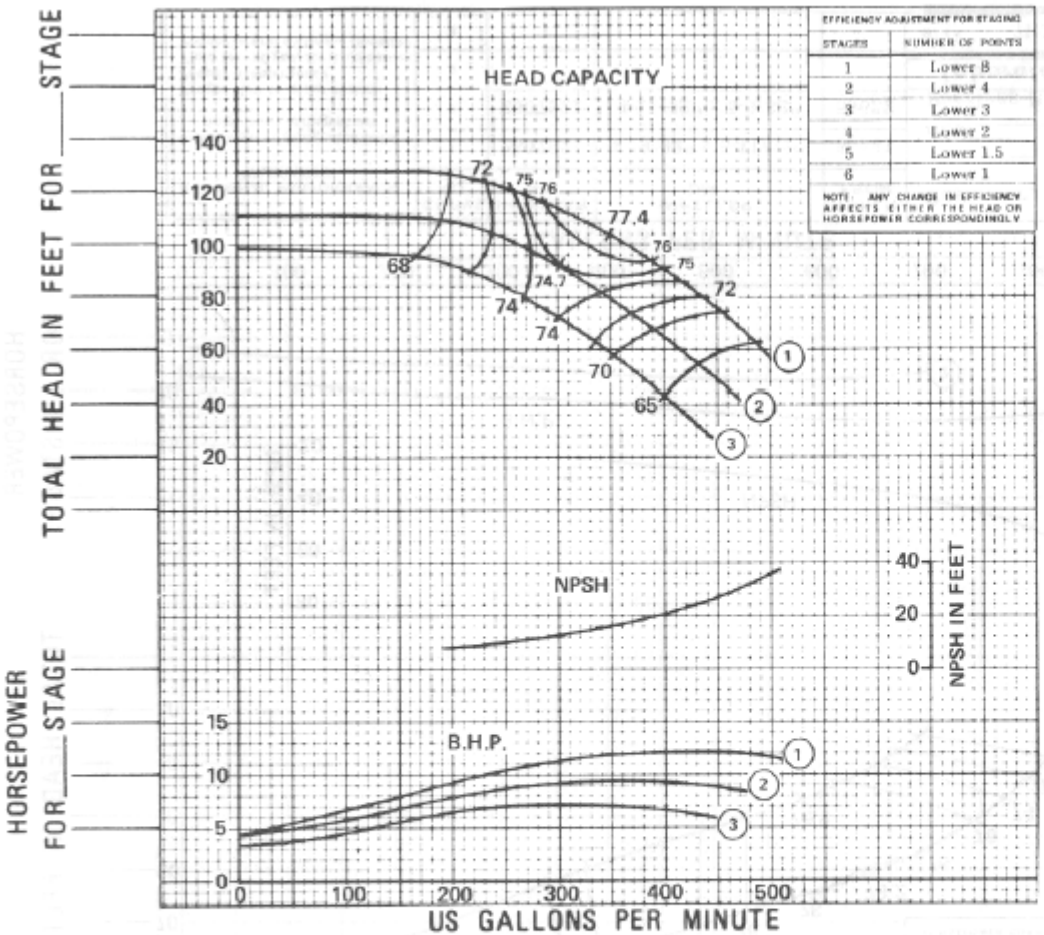

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 8
2	Lower 4
3	Lower 3
4	Lower 2
5	Lower 1.5
6	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

2 POLE 60 HERTZ PERFORMANCE

GUARANTEED PERFORMANCE

◯ Bowl

◯ Field

Capacity _____ gpm

Head _____ Feet

BHP _____

EFFICIENCY _____ %

DRIVER

_____

_____

HEAD

_____

COLUMN

_____

_____

_____

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on:	1	2616464	5-15/16	55542
Proper flow to pump suction	2	2616464	5-1/2 x 5-23/32	55712
Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	3	2616464	5-3/16 x 5-1/2	55666
	4			

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance		BOWL	2616457 CIE
SIZE 8LB	RPM 3460	CURVE	4806268

Peerless Pump
A Sterling Company